

# TECHNICAL GUIDE



# PREDATOR<sup>®</sup>

## STANDARD EFFICIENCY SINGLE PACKAGE AIR CONDITIONERS AND SINGLE PACKAGE GAS/ELECTRIC UNITS

DM 078, 090, 102, 120 and 150  
6-1/2, 7-1/2, 8-1/2, 10 and 12-1/2 NOMINAL TONS  
9.0 EER



## DESCRIPTION

YORK<sup>®</sup> Predator<sup>®</sup> units are convertible single packages with a common footprint cabinet and common roof curb for all 6-1/2 through 12-1/2 ton models. All units have two compressors with independent refrigeration circuits to provide two stages of cooling. The units were designed for commercial applications and can be easily installed on a roof curb, slab, or frame.

All Predator<sup>®</sup> units are self-contained and assembled on rigid full perimeter base rails allowing for 3-way forklift access and overhead rigging. Every unit is completely charged, wired, piped, and tested at the factory to provide a quick and easy field installation.

All units are convertible between side and down airflow. A independent economizer design is used on side and down discharge applications, as well as all tonnage sizes.

Predator<sup>®</sup> units are available in the following configurations: cooling only, cooling with electric heat, and cooling with gas heat. Electric heaters are available as factory-installed options or field-installed accessories.

*Tested in accordance with:*



## TABLE OF CONTENTS

<b>DESCRIPTION</b> .....	<b>1</b>
<b>FEATURES</b> .....	<b>3</b>
<b>FACTORY INSTALLED OPTIONS</b> .....	<b>5</b>
<b>FIELD INSTALLED ACCESSORIES</b> .....	<b>6</b>
<b>NOMENCLATURE</b> .....	<b>9</b>
<b>GUIDE SPECIFICATIONS</b> .....	<b>45</b>

### LIST OF FIGURES


<u>Fig. #</u>	<u>Pg. #</u>
1 PREDATOR® COMPONENT LOCATION .....	3
2 POWER EXHAUST ACCESSORY DOWNFLOW APPLICATION .....	36
3 POWER EXHAUST ACCESSORY HORIZONTAL APPLICATION .....	37
4 UNIT 4 POINT LOAD .....	37
5 UNIT CENTER OF GRAVITY .....	37
6 UNIT 6 POINT LOAD .....	37
7 UNIT DIMENSIONS .....	38
8 PREDATOR® ROOF CURB DIMENSIONS .....	39
9 SUNLINE™ TO PREDATOR® TRANSITION ROOF CURBS .....	40
10 BOTTOM DUCT OPENINGS (FROM ABOVE) .....	40
11 REAR DUCT DIMENSIONS .....	41
12 COOLING UNIT WITH GAS HEAT WIRING 230 VOLT DIAGRAM .....	42
13 COOLING UNIT WITH/WITHOUT ELECTRIC HEAT WIRING DIAGRAM .....	43
14 COOLING UNIT WITH GAS HEAT WIRING 460, 575 VOLT AND 50 HZ DIAGRAM .....	44

### LIST OF TABLES

<u>Tbl. #</u>	<u>Pg. #</u>
1 ACCESSORIES .....	8
2 PHYSICAL DATA .....	13
3 DM CAPACITY RATINGS .....	14
4 UNIT VOLTAGE LIMITATIONS .....	14
5 COOLING CAPACITY 6-1/2 TON UNIT .....	15
6 COOLING CAPACITY 7-1/2 TON UNIT .....	16
7 COOLING CAPACITY 8-1/2 TON UNIT .....	17
8 COOLING CAPACITY 10 TON UNIT .....	18
9 COOLING CAPACITY 12-1/2 TON UNIT .....	19

### LIST OF TABLES (cont.)

<u>Tbl. #</u>		<u>Pg. #</u>
10	ELECTRICAL DATA DM078 (6-1/2 TON) STD EFFICIENCY W/O PWRD CONV. OUTLET .....	20
11	ELECTRICAL DATA DM078 (6-1/2 TON) STD EFFICIENCY WITH PWRD CONV. OUTLET .....	20
12	ELECTRICAL DATA DM090 (7-1/2 TON) STD EFFICIENCY W/O PWRD CONV. OUTLET .....	21
13	ELECTRICAL DATA DM090 (7-1/2 TON) STD EFFICIENCY WITH PWRD CONV. OUTLET .....	21
14	ELECTRICAL DATA DM102 (8-1/2 TON) STD EFFICIENCY W/O PWRD CONV. OUTLET .....	22
15	ELECTRICAL DATA DM102 (8-1/2 TON) STD EFFICIENCY WITH PWRD CONV. OUTLET .....	22
16	ELECTRICAL DATA DM120 (10 TON) STD EFFICIENCY W/O PWRD CONV. OUTLET .....	23
17	ELECTRICAL DATA DM120 (10 TON) STD EFFICIENCY WITH PWRD CONV. OUTLET .....	23
18	ELECTRICAL DATA DM150 (12-1/2 TON) STD EFFICIENCY W/O PWRD CONV. OUTLET .....	24
19	ELECTRICAL DATA DM150 (12-1/2 TON) STD EFFICIENCY W/PWRD CONV. OUTLET .....	24
20	ELECTRIC HEAT MULTIPLIERS .....	24
21	BLOWER PERF. 6-1/2 TON SIDE DUCT .....	25
22	BLOWER PERF. 7-1/2 TON SIDE DUCT .....	26
23	BLOWER PERF. 8-1/2 TON SIDE DUCT .....	27
24	BLOWER PERF. 10 TON SIDE DUCT .....	28
25	BLOWER PERF. 12-1/2 TON SIDE DUCT .....	29
26	BLOWER PERF. 6-1/2 TON DOWNSHOT .....	30
27	BLOWER PERF. 7-1/2 TON DOWNSHOT .....	31
28	BLOWER PERF. 8-1/2 TON DOWNSHOT .....	32
29	BLOWER PERF. 10 TON DOWNSHOT .....	33
30	BLOWER PERF. 12-1/2 TON DOWNSHOT .....	34
31	ADDITIONAL STATIC RESISTANCE .....	35
32	ELECTRIC HEAT MINIMUM SUPPLY AIR CFM .....	35
33	INDOOR BLOWER SPECIFICATIONS .....	36
34	POWER EXHAUST SPECIFICATIONS .....	36
35	4 POINT LOAD WEIGHT .....	37
36	6 POINT LOAD WEIGHT .....	38
37	UNIT WEIGHT .....	38
38	UNIT CLEARANCES .....	38

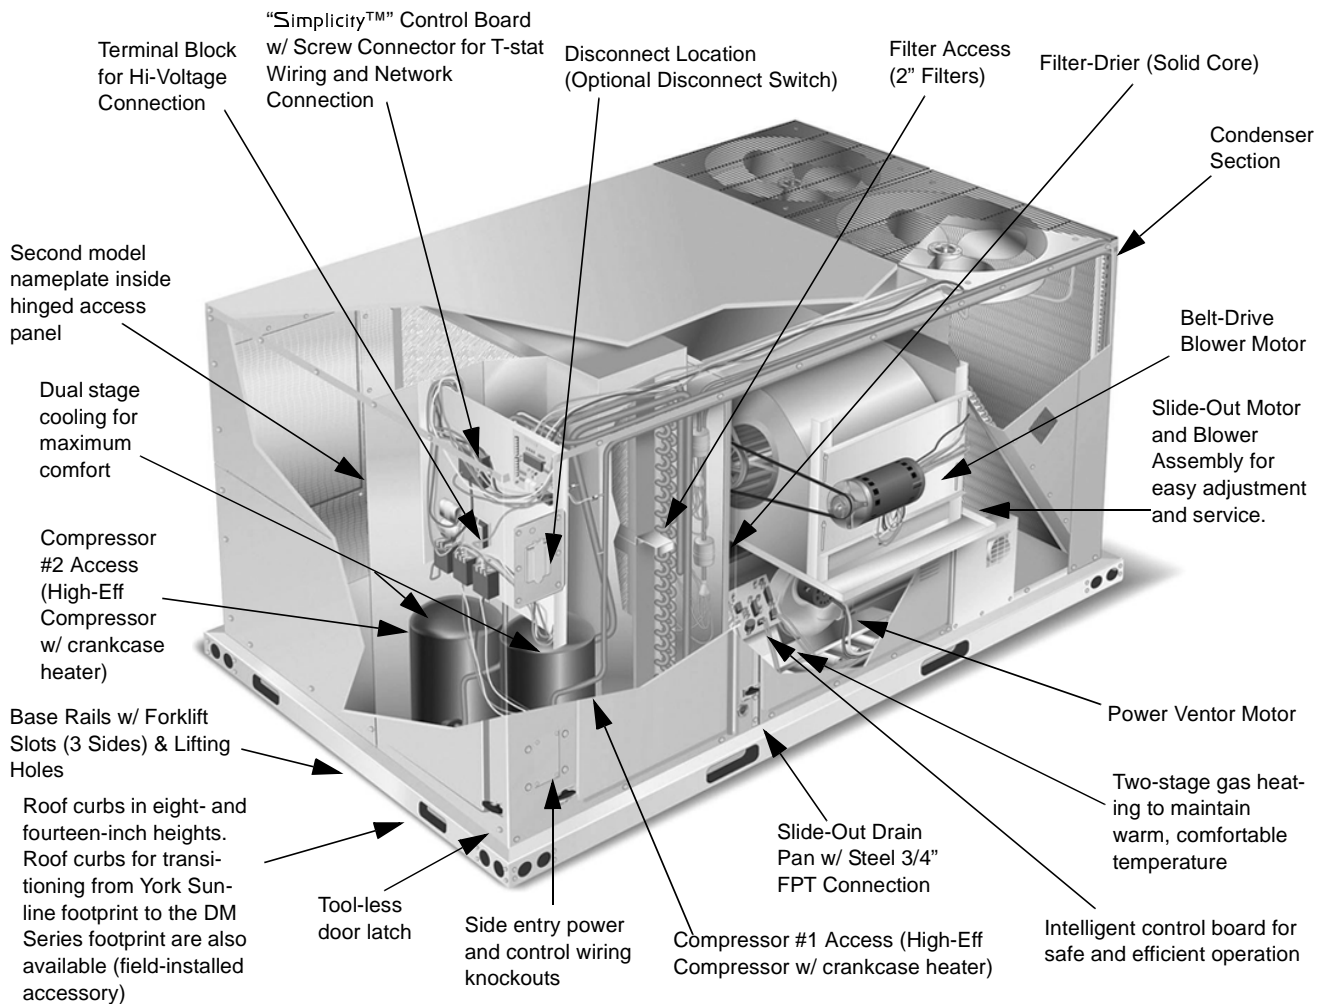

**FIGURE 1 - PREDATOR® COMPONENT LOCATION**

## FEATURES

- **Standard Efficiency**— All standard efficiency units have a minimum EER of 9.0. Gas/electric units have electronic spark ignition and power vented combustion with steady state efficiencies of 80%.
- **Service Friendly** – The Predator® incorporates a number of enhancements which improve serviceability.

The motor and blower slide out of the unit as a common assembly. This facilitates greater access to all the indoor airflow components, thus simplifying maintenance and adjustment.

Service time is reduced through the use of hinged, tool-less panels. Such panels provide access to frequently inspected components and areas, including the control box, compressors, filters, indoor motor & blower, and the heating section. The panels are screwed in place at the factory to prevent access by children or other unauthorized persons. It is recommended that the panels be secured with screws once service is complete.

Service windows have been placed in both condenser section walls. Rotation of the cover allows easy access to the condenser coils for cleaning or inspection.

Both the unit control board and ignition control board utilize flash codes to aid in diagnosis of unit malfunctions. Unique alarm codes quickly identify the source of the unit alarm.

All units use the same standard filter size. This standardization removes any confusion on which filter sizes are needed for replacement.

The non-corrosive drain pan slides out of the unit to permit easy cleaning. The drain pan is accessed by removing the drain pan cover plate on the rear of the unit. Once the plate is removed, the drain pan slides out through the rear of the unit.

All Predator® units have a second model nameplate located inside the control access door. This is to prevent deterioration of the nameplate through weathering.

- **Environmentally Aware** – For improved Indoor Air Quality, foil faced insulation is used exclusively throughout the units.
- **Balanced Heating** – The Predator® offers “Ultimate Heating Comfort” with a balance between 1<sup>st</sup> and 2<sup>nd</sup> stage gas heating. The 1<sup>st</sup> stage of a gas heat Predator® unit provides 60% of the heating capacity. Balanced heating allows the unit to better maintain desired temperatures.
- **Convertible Airflow Design** – The side duct openings are covered when they leave the factory. If a side supply/return is desired, the installer simply removes the two side duct covers from the outside of the unit and installs them over the down shot openings. No panel cutting is required. Convertible airflow design allows maximum field flexibility and minimum inventory.
- **System Protection** - Suction line freezestats are supplied on all units to protect against loss of charge and coil frosting when the economizer operates at low outdoor air temperatures while the compressors are running. Every unit has solid-core liquid line filter-driers and high and low-pressure switches. Internal compressor protection is standard on all compressors. Crankcase heaters are standard on reciprocating compressors. Scroll compressors do not require crankcase heaters. Phase Monitors are standard on units with scroll compressors. This accessory monitors the incoming power to the unit and protects the unit from phase loss and reversed phase rotation.
- **Advanced Controls** - Simplicity™ control boards have standardized a number of features previously available only as options or by utilizing additional controls.
  - **Low Ambient** - An integrated low-ambient control allows all units to operate in the cooling mode down to 0°F outdoor ambient without additional assistance. Optionally, the control board can be programmed to lockout the compressors when the outdoor air temperature is low or when free cooling is available.
  - **Anti-Short Cycle Protection** - To aid compressor life, an anti-short cycle delay is incorporated into the standard controls. Compressor reliability is further ensured by programmable minimum run times. For testing, the anti-short cycle delay can be temporarily overridden with the push of a button.
  - **Fan Delays** - Fan on and fan off delays are fully programmable. Furthermore, the heating and cooling fan delay times are independent of one another. All units are programmed with default values based upon their configuration of cooling and heat.
  - **Safety Monitoring** - The control board monitors the high and low-pressure switches, the freezestats, the gas valve, if applicable, and the temperature limit switch on gas and electric heat units. The unit control board will alarm on ignition failures, compressor lockouts and repeated limit switch trips.
- **Nuisance Trip Protection and Strikes** - To prevent nuisance trouble calls, the control board uses a “three times, you’re out” philosophy. The high and low-pressure switches and the freezestats must trip three times within two hours before the unit control board will lock out the associated compressor.
- **On Board Diagnostics** - Each alarm will energize a trouble light on the thermostat, if so equipped, and flash an alarm code on the control board LED. Each high and low-pressure switch alarm as well as each freezestat alarm has its own flash code. The control board saves the five most recent alarms in memory, and these alarms can be reviewed at any time. Alarms and programmed values are retained through the loss of power.
- **Reliable** – From the beginning – All units undergo computer automated testing before they leave the factory. Units are tested for refrigerant charge and pressure, unit amperage, and 100% functionality. For the long term – All Predator® units are painted with a long lasting, powder paint that stands up over the life of the unit. The paint used has been proven by a 750 hour salt spray test.
- **Flexible Placement** – All models and configurations share the same cabinet/footprint and thus the same roof curb. You have the flexibility to set one curb and choose the correct tonnage size and heating option after the internal loads have been determined.
 

To further simplify planning and installation, Predator® cabinets are designed to fit your roof. With the optional roof curb, the unit ductwork is designed to fit around 24” on-center joists or between 48” on-center joists.

The drain pan can be rotated to drain to either the front or the rear of the unit. Additionally, the drain pan can be piped to drain through the roof curb. As it is sometimes difficult to have a level installation, the drain pan features a generous slope to ensure proper drainage.
- **Full Perimeter Base Rails** – The permanently attached base rails provide a solid foundation for the entire unit and protect the unit during shipment. The rails offer fork-lift access from 3 sides, and rigging holes are available so that an overhead crane can be used to place the units on a roof.
- **Easy Installation** – Gas and electric utility knockouts are supplied in the unit underside as well as the side of the unit. A clearly identified location is provided to mount a field supplied electrical disconnect switch. Utility connections can be made quickly and with a minimum amount of field labor.
 

All units are shipped with 2” filters installed.
- **Wide Range of Indoor Airflows** – All indoor fan motors are belt-drive type providing maximum flexibility to handle most airflow requirements. For high static applications, factory installed alternate indoor fan motors are available. With the optional indoor fan motor, all units can supply nominal airflow at a minimum of 1.5” ESP.

- **Warranty** - All models include a 1-year limited warranty on the complete unit. Compressors and electric heater elements each carry a 5-year warranty. Aluminized steel and stainless steel tubular heat exchangers carry an additional 10-year warranty.

## FACTORY INSTALLED OPTIONS

YORK® offers several equipment options factory installed, for the Predator® line.

- **Downflow Economizer - (With barometric relief)** - The economizer is provided with a single enthalpy input. The economizer is 2% low leakage type, and is shipped installed and wired. The installer needs only to assemble and mount the outdoor air hood (Provided). The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the standard single enthalpy input. There is an optional input dual dry bulb available. To meet regulated air standards, the economizer control accepts an optional CO<sub>2</sub> input for demand ventilation. With single enthalpy input, the economizer control monitors outdoor air. The dual enthalpy kit provides a second input used to monitor the return air. With a dual input kit installed, the economizer control compares the values of the two enthalpy or temperature inputs and positions the dampers to provide the maximum efficiency possible.
- **Horizontal Economizer - (Without barometric relief)** - All features of the downflow economizer exist except you must order the duct mount barometric relief separately. **You must order a 1EH0408 if you are installing a power exhaust. You can order a 1RD0411 Barometric Relief for horizontal flow economizers only.**
- **BAS Ready Economizer -(With barometric relief)** - The economizer is provided with a Belimo actuator that requires a 0-10V DC input from an external source (i.e., field installed building automation system controller). Power exhaust options are available. The economizer is 2% low leakage type with spring return and fully modulating dampers capable of introducing up to 100% outside air. Also include 2" pleated filters.
- **Slab Economizer for Energy Recovery Ventilators-(With barometric relief and Fresh Air Hood)** - The economizer is provided with a single enthalpy input. The economizer is 2% low leakage type, and is shipped installed and wired. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the standard single enthalpy input. There is an optional input dual dry bulb available. To meet regulated air standards, the economizer control accepts an optional CO<sub>2</sub> input for demand ventilation.

With single enthalpy input, the economizer control monitors outdoor air. The dual enthalpy kit provides a second input used to monitor the return air. With a dual input kit installed, the economizer control compares the values of the two enthalpy or temperature inputs and positions the dampers to provide the maximum efficiency possible.

- **Power Exhaust (Downflow only)** - This accessory installs in the unit with a down flow economizer.
- **Motorized Outdoor Air Damper** - The motorized outdoor air damper includes a slide-in/plug-in damper assembly with an outdoor air hood and filters. The outdoor air dampers open to the preset position when the indoor fan motor is energized. The damper has a range of 0% to 100% outdoor air entry. Factory installed option or field installed accessory.
- **Alternate Indoor Blower Motor** - For applications with high static restrictions, units are offered with optional indoor motors that provide higher static output and/or higher airflow, depending upon the installer's needs.
- **Aluminized Steel Gas Heat Exchanger** - For applications in non-corrosive environments.
- **Stainless Steel Gas Heat Exchanger** - For applications in corrosive environments, this option provides a full stainless steel heat exchanger assembly.
- **Stainless Steel Drain Pan** - An optional rust-proof stainless steel drain pan is available to provide years of trouble-free operation in corrosive environments.
- **Electric Heaters** - The electric heaters range from 9kW to 54kW and are available in all the voltage options of the base units. All heaters are dual staged. All heaters are intended for single point power supply.
- **Disconnect Switch** - For gas heat units and cooling units with electric heat, an HACR breaker sized to the unit is provided. For cooling only units, a switch sized to the largest electric heat available for the particular unit is provided. Factory installed option only.
- **Convenience Outlet - (Non-Powered /Powered)** - This option locates a 120V single-phase GFCI outlet with cover, on the corner of the unit housing adjacent to the compressors. The "Non-powered" option requires the installer to provide the 120V single-phase power source and wiring. The "Powered" option is powered by a step-down transformer in the unit. Factory installed option only.
- **Smoke Detectors** - The smoke detectors stop operation of the unit by interrupting power to the control board if smoke is detected within the air compartment. Available for both the supply and/or return air.
- **Phase Monitors** - Designed to prevent unit damage. The phase monitor will shut the unit down in an out-of phase condition. **(Standard on units with Scroll Compressors.)**

- **Coil Guard** - Customers can purchase a coil guard kit to protect the condenser coil from damage. Additionally, this kit stops animals and foreign objects from entering the space between the inner condenser coil and the main cabinet. This is not a hail guard kit.
- **Dirty Filter Switch** - This kit includes a differential pressure switch that energizes the fault light on the unit thermostat, indicating that there is an abnormally high pressure drop across the filters. Factory installed option or field installed accessory.
- **Technicoat Condenser Coils** - The condenser coils are coated with a phenolic coating for protection against corrosion due to harsh environments.
- **Technicoat Evaporator Coil** - The evaporator coils are coated with a phenolic coating for protection against corrosion due to harsh environments.
- **BAS - Building Automation System Controls** **Simplicity™ INTELLI-Comfort™ Control** - The York® Simplicity™ INTELLI-Comfort™ control is factory installed. It includes a supply air sensor, a return air sensor, and an outside air sensor. There are provisions for a field installed dirty filter indicator switch, an air-proving switch, an Outside Air Humidity sensor, a Return Air Humidity sensor, an Inside IAQ sensor, and an Outside Air IAQ sensor. Construction mode operation, 365-day real time clock with 7 day programming plus holiday scheduling is built-in. Two different modes of demand ventilation are achieved through the INTELLI-Comfort™ using CO<sub>2</sub> sensors. It uses an inside CO<sub>2</sub> sensor to perform Demand Ventilation. It can also use an Outside CO<sub>2</sub> sensor to perform Differential Demand Ventilation. It uses a Patented Comfort Ventilation algorithm to provide comfortable ventilation air temperature. The patented economizer-loading algorithm will protect the equipment when harsh operating conditions exist. Humidity in the occupied space or return duct can be monitored and controlled via humidity sensors and the on-board connection for hot gas re-heat system. It uses the INTELLI-Start™ algorithm to maximize energy savings by recovering the building from the Unoccupied Setpoints to the Occupied Setpoints just in time for the Occupied Time Period to begin. The Simplicity™ INTELLI-Comfort™ balances space temperature, ventilation air temperature, CO<sub>2</sub> and humidity for ultimate comfort.
- **Simplicity™ INTELLI-Comfort™ with ModLINC Control** - The York® Simplicity™ INTELLI-Comfort™ with ModLINC control is factory installed. It includes all the features of the INTELLI-Comfort™ control with an additional control to translate communications from MODBUS to the BACnet MSTP protocol.
- **Novar® BAS Control** - The Novar® ETC-3 building automation system controller is factory installed. Includes supply air sensor, return air sensor, dirty filter indicator switch, and air proving switch.
- **Johnson Controls BAS Control** - The Johnson Control YK-UNT-1126 building automation system controller is

factory installed. Includes supply air sensor, return air sensor, dirty filter indicator switch, and air proving switch.

- **CPC BAS Control** - The Computer Process Controls Model 810-3060 ARTC Advanced Rooftop building automation system controller is factory installed. Includes supply air sensor, return air sensor, dirty filter indicator switch and air proving switch.
- **Honeywell BAS Control** - The Honeywell W7750C building automation system controller is factory installed. Includes air supply sensor, return air sensor, dirty filter indicator switch, and air proving switch.

## FIELD INSTALLED ACCESSORIES

YORK® offers several equipment accessories for field installation, for the Predator® line.

- **Downflow Economizer - (With barometric relief)** - The economizer is provided with a single enthalpy input. The economizer is 2% low leakage type. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the standard single enthalpy input. There is an optional input dual dry bulb available. To meet regulated air standards, the economizer control accepts an optional CO<sub>2</sub> input for demand ventilation. With single enthalpy input, the economizer control monitors outdoor air. The dual enthalpy kit provides a second input used to monitor the return air. With a dual input kit installed, the economizer control compares the values of the two enthalpy or temperature inputs and positions the dampers to provide the maximum efficiency possible
- **Horizontal Economizer - (Without barometric relief)** - All features of the downflow economizer exist except you must order the duct mount barometric relief separately. **You must order a 1EH0408 if you are installing a power exhaust. You can order a 1RD0411 Barometric Relief for horizontal flow economizer.**
- **Slab Economizer for Energy Recovery Ventilator - (Without barometric relief or Fresh Air Hood)** - The economizer is provided with a single enthalpy input. The economizer is 2% low leakage type. The economizer has spring return, fully modulating damper actuators and is capable of introducing up to 100% outdoor air. As the outdoor air intake dampers open, the return air dampers close. The changeover from mechanical refrigeration to economizer operation is regulated by the standard single enthalpy input. There is an optional input dual dry bulb available. To meet regulated air standards, the economizer control accepts an optional CO<sub>2</sub> input for demand ventilation. With single enthalpy input, the economizer control monitors outdoor air. The dual enthalpy kit provides a second input used to monitor the return air. With a dual input kit installed, the economizer control compares the values of the two enthalpy or temperature

inputs and positions the dampers to provide the maximum efficiency possible.

**You can order 1EH0409 Barometric Relief/FA Hood for field installations without an ERV.**

- **Dual Enthalpy Control, Accessory** - This kit contains the required components to convert a single enthalpy economizer to dual enthalpy.
- **Barometric Relief Damper** - Zero to 100% capacity barometric relief dampers for use with horizontal flow, or field installed slab economizers.
- **Power Exhaust** - This accessory installs in the unit with a down flow economizer. Power exhaust plugs into the connector in the unit bulkhead. **You must purchase 1EH0408 barometric relief when applying to a horizontal flow application.**
- **Manual Outdoor Air Damper** - Like the motorized outdoor air damper, each manual outdoor air damper includes a slide-in damper assembly with an outdoor air hood and filters. Customers have a choice of dampers with ranges of 0% to 100% or 0% to 35% outdoor air entry.
- **Motorized Outdoor Air Damper** - The motorized outdoor air damper includes a slide-in/plug-in damper assembly with an outdoor air hood and filters. The outdoor air dampers open to the preset position when the indoor fan motor is energized. The damper has a range of 0% to 100% outdoor air entry. Factory installed option or field installed accessory.
- **Smoke Detectors** - The smoke detectors stop operation of the unit by interrupting power to the control board if smoke is detected within the air compartment.
- **CO<sub>2</sub> Sensor** - Senses CO<sub>2</sub> levels and automatically overrides the economizer when levels rise above the preset limits.
- **Dirty Filter Switch** - This kit includes a differential pressure switch that energizes the fault light on the unit thermostat, indicating that there is an abnormally high pressure drop across the filters.
- **Coil Guard** - Field installed decorative wire coil guard.
- **Hail Guard** - This kit includes a sloped hood which installs over the outside condenser coil and prevents damage to the coil fins from hail strikes. Field installed accessory only.
- **Flue Exhaust Extension Kit** - In locations with wind or weather conditions which may interfere with proper exhausting of furnace combustion products, this kit can be installed to prevent the flue exhaust from entering nearby fresh air intakes.
- **-60°F Gas Heat Kit** - For installations which require gas heat units to perform in low ambient temperatures, a gas section heating kit is available. This kit provides electric heat in the gas heat controls section to ensure the gas valve and controls will continue to function properly at extremely low temperatures.
- **Gas Heat High Altitude Kit** - This kit converts a gas heat unit to operate at high altitudes, 2,000 to 6,000 feet. Conversion kits are available for natural gas and propane.
- **Gas Heat Propane Conversion Kit** - This kit converts a gas-fired heater from natural gas to propane. It contains the main burner orifices and gas valve replacement springs.
- **Gas Piping Kit** - Contains pipe nipples, fittings and gas cock required for gas supply connection with external shut off.
- **Electric Heaters** - The electric heaters range from 9 kW to 54kW and are available in all the voltage options of the base units. All heaters are dual staged. Cooling units include an adapter panel for easy installation of the electric heaters. Necessary hardware and connectors are included with the heaters. All heaters are intended for single point power supply.
- **Low Limit / Compressor Lockout Kit**
  1. **Compressor Lockout (CLO):** To prevent mechanical (compressorized) operation of the unit during cold outdoor conditions where there is a risk of returning liquid refrigerant back to the compressors.
  2. **Low Limit Control (LLC):** To prevent the supply air from dropping below a specified setpoint by utilizing the units first stage heating means when there is a demand for cooling during cold outside conditions.
- **Metal Frame Filter Kit** - Metal frame with polyester filter medium.
- **Permanent Filters** - Permanent filters are available.
- **Roof Curbs** - The roof curbs have insulated decks and are shipped disassembled. The roof curbs are available in 8" and 14" heights. For applications with security concerns, burglar bars are available for the duct openings of the roof curbs.
- **Roof Curb Transition** - Single Piece Adapter (10" High) - Roof curbs for transitioning from Sunline™ units to Predator® units. Fits 7.5 to 12.5 Sunline™ roof curbs only.
- **Burglar Bars** - Mount in the supply and return openings to prevent entry into the duct work.
- **Thermostat** - The units are designed to operate with 24-volt electronic and electro-mechanical thermostats. All units (with or without an economizer) operate with two-stage heat/two-stage cool or two-stage cooling only thermostats, depending upon unit configuration.


**TABLE 1: ACCESSORIES**

<b>Part Number</b>	<b>Description</b>	<b>Weight</b>
1RC0470	Roof Curb, 8" Height	-
1RC0471	Roof Curb, 14" Height	-
1RC0472	Roof Curb, Transition (7.5 T through 12.5 T)	-
1BD0408	Burglar Bars, Downflow	-
2TP04520925	Electric Heat 9kW 230V	-
2TP04521825	Electric Heat 18kW 230V	-
2TP04522425	Electric Heat 24kW 230V	-
2TP04523625	Electric Heat 36kW 230V	-
2TP04525425	Electric Heat 54kW 230V	-
2TP04520946	Electric Heat 9kW 460V	-
2TP04521846	Electric Heat 18kW 460V	-
2TP04522446	Electric Heat 24kW 460V	-
2TP04523646	Electric Heat 36kW 460V	-
2TP04525446	Electric Heat 54kW 460V	-
2TP04520958	Electric Heat 9kW 575V	-
2TP04521858	Electric Heat 18kW 575V	-
2TP04522458	Electric Heat 24kW 575V	-
2TP04523658	Electric Heat 36kW 575V	-
2TP04525458	Electric Heat 54kW 575V	-
1FA0411	Manual Outside Air Damper 0-35%, Downflow (Incl. Hood, Damper & Filters, No Barometric Relief)	-
1FA0412	Manual Outside Air Damper 0-100%, Downflow (Incl. Hood, Damper & Filters, No Barometric Relief)	-
2MD04702724	Motorized Damper, Downflow (Incl. Hood, Damper & Filter, no Barometric Relief)	-
2MD04703324	Motorized Damper, Horizontal (Incl. Hood, Damper & Filter, no Barometric Relief)	-
2EE04705024	Economizer, Downflow (Incl. Barometric Relief & All Hoods)	124 lbs.
2EE04705124	Economizer, Horizontal (Incl. Dampers & Hoods, no Barometric Relief)	97 lbs.
2EE04705224	Economizer, Slab, Downflow (Incl. Dampers only no Hoods or Barometric Relief)	-
2PE04703225	Power Exhaust, Downflow, 230V (For Units with Economizer only)	-
2PE04703246	Power Exhaust, Downflow, 460V (For Units with Economizer only)	-
2PE04703258	Power Exhaust, Downflow, 580V (For Units with Economizer only)	-
2EC04700924	Dual Enthalpy Control (Use with Single Enthalpy Economizer)	-
1EH0407	Hood Kit, Downflow Economizer (Included with all Downflow Economizers)	-
1RD0411	Barometric Relief Kit, Ductmount for Horizontal Application (Incl. Damper & Hood)	-
1EH0408	Barometric Relief Kit, Ductmount for Horizontal Application w/ Power Exhaust (Incl. Damper & Hood)	25 lbs.
1EH0409	Barometric Relief / Hood Kit, for Field Installed Slab Econ. w/o ERV (Incl. Barometric Relief & FA Hood)	-
2AQ04700424	CO2 Detector Unit Mount	-
2AQ04700324	CO2 Detector Space Mount	-
2SD04700424	Smoke Detector, Supply or Return (Return Not Available with Horizontal Economizer)	-
2MK04700624	Low Limit / Compressor Lockout Kit	-
1CG0419	Coil Guard (Electric / Electric & HP models)	-
1CG0420	Coil Guard (Gas / Electric models)	-
1HG0411	Hail Guard Kit	-
1GP0404	Gas Piping Kit	-
1NP0441	Propane Conversion Kit	-
1HA0442	High Altitude Kit for Natural Gas	-
1HA0443	High Altitude Kit for Propane	-
1FE0411	Flue Exhaust Extension Kit	-
2BC04700106	Gas Heat Kit, -60 deg F, 230V	-
2BC04700151	Gas Heat Kit, -60 deg F, 460V	-
2BC04700154	Gas Heat Kit, -60 deg F, 575V	-
1FL0402	Permanent Filter Kit	-
2DF0401	Dirty Filter Switch	-
1FF0410	Filter Frame Kit, Metal	-



# NOMENCLATURE

## 6½ - 12½ Ton Predator Model Number Nomenclature

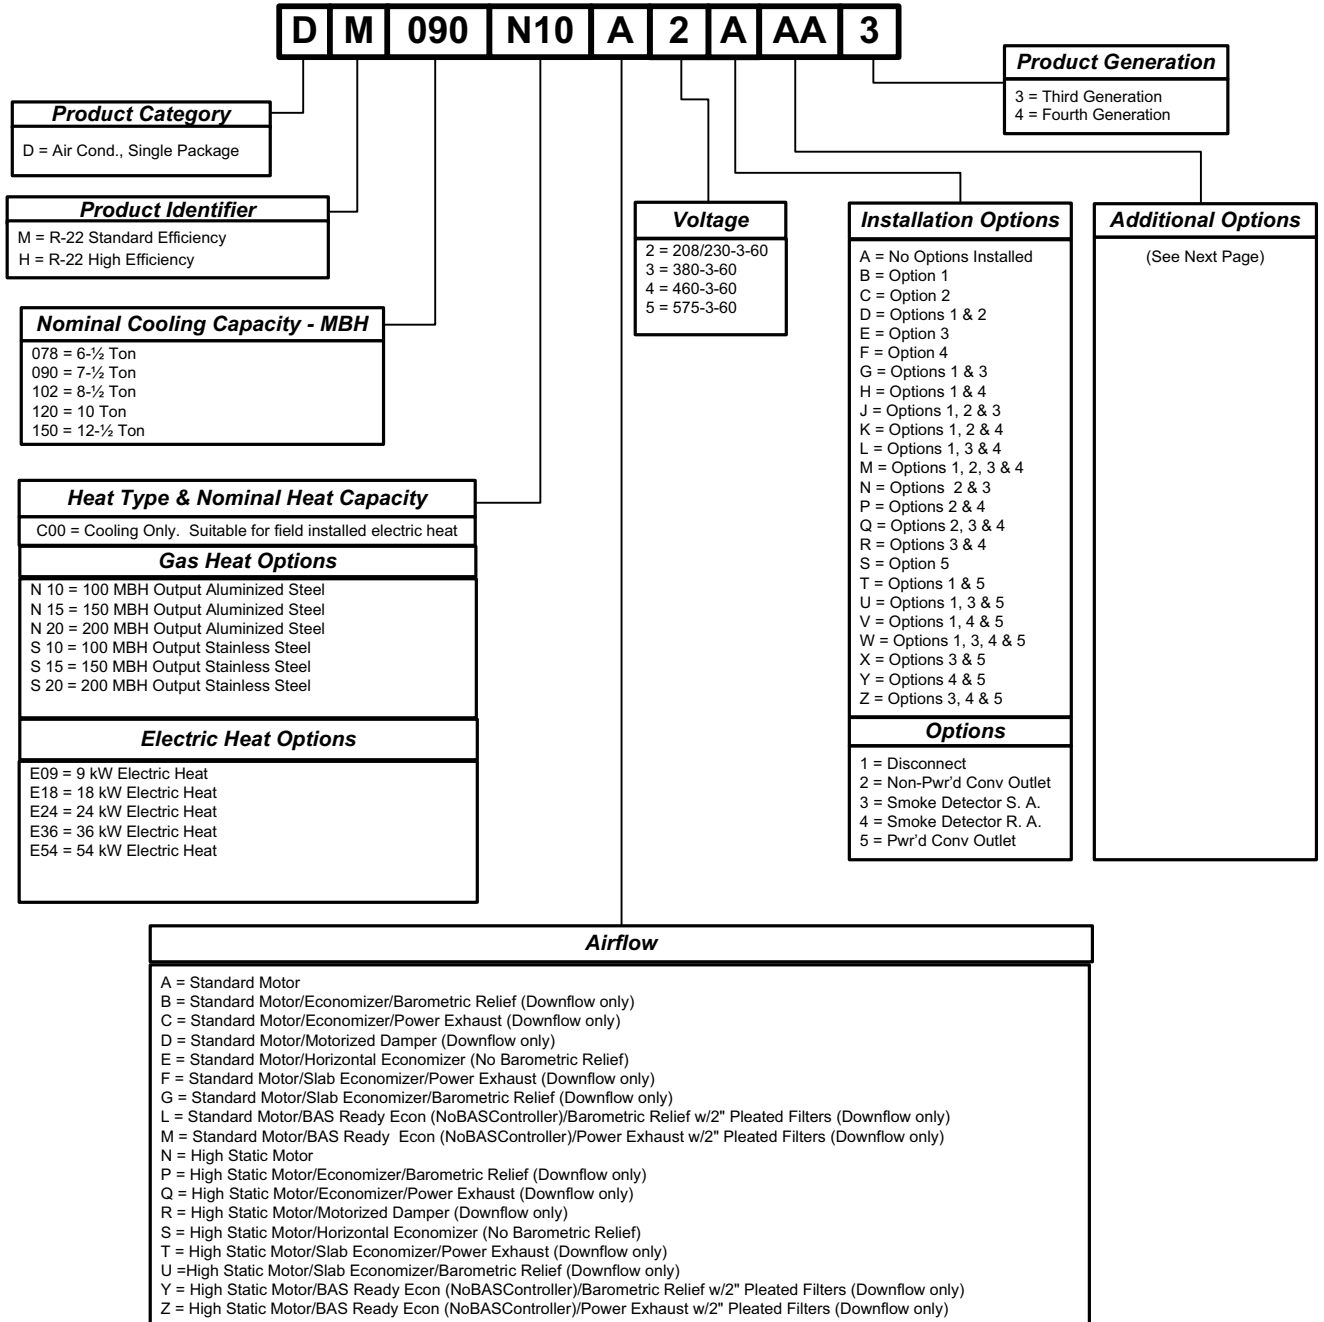

**NOMENCLATURE ADDITIONAL OPTIONS**

Additional Options	
AA	None
AB	Phase Monitor
AC	Coil Guard
AD	Dirty Filter Switch
AE	Phase Monitor & Coil Guard
AF	Phase Monitor & Dirty Filter Switch
AG	Coil Guard & Dirty Filter Switch
AH	Phase Monitor, Coil Guard, & Dirty Filter Switch
AJ	SS Drain Pan
AK	SS Drain Pan & Phase Monitor
AL	SS Drain Pan & Coil Guard
AM	SS Drain Pan & Dirty Filter Switch
AN	SS Drain Pan, Phase Monitor, Coil Guard & Dirty Filter Switch
CA	CPC Controller with Dirty Filter Switch & Air Proving Switch
CB	CPC Controller, DFS, APS & Phase Monitor
CC	CPC Controller, DFS, APS & Coil Guard
CD	CPC Controller, DFS, APS, Phase Monitor, & Coil Guard
CE	CPC Controller, DFS, APS & Technicoat Cond. Coil
CF	CPC Controller, DFS, APS, Technicoat Cond. Coil, & Phase Monitor
CG	CPC Controller, DFS, APS, Technicoat Cond. Coil, & Coil Guard
CH	CPC Controller, DFS, APS, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
CJ	CPC Controller, DFS, APS & Technicoat Evap. Coil
CK	CPC Controller, DFS, APS, Technicoat Evap. Coil, & Phase Monitor
CL	CPC Controller, DFS, APS, Technicoat Evap. Coil, & Coil Guard
CM	CPC Controller, DFS, APS, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
CN	CPC Controller, DFS, APS & Technicoat Evap. & Cond Coils
CP	CPC Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Phase Monitor
CQ	CPC Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Coil Guard
CR	CPC Controller, DFS, APS, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
CS	CPC Controller, DFS, APS, SS Drain Pan
CT	CPC Controller, DFS, APS, SS Drain Pan, Phase Monitor, & Coil Guard
CU	CPC Controller, DFS, APS, SS Drain Pan, & Technicoat Cond Coils
CV	CPC Controller, DFS, APS, SS Drain Pan, & Technicoat Evap Coil
CW	CPC Controller, DFS, APS, SS Drain Pan, & Technicoat Evap and Cond Coils
CX	CPC Controller, DFS, APS, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils
JA	Johnson UNT Controller with Dirty Filter Switch & Air Proving Switch
JB	Johnson UNT Controller, DFS, APS & Phase Monitor
JC	Johnson UNT Controller, DFS, APS & Coil Guard
JD	Johnson UNT Controller, DFS, APS, Phase Monitor, & Coil Guard
JE	Johnson UNT Controller, DFS, APS & Technicoat Cond. Coil
JF	Johnson UNT Controller, DFS, APS, Technicoat Cond. Coil, & Phase Monitor
JG	Johnson UNT Controller, DFS, APS, Technicoat Cond. Coil, & Coil Guard
JH	Johnson UNT Controller, DFS, APS, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
JJ	Johnson UNT Controller, DFS, APS & Technicoat Evap. Coil
JK	Johnson UNT Controller, DFS, APS, Technicoat Evap. Coil, & Phase Monitor
JL	Johnson UNT Controller, DFS, APS, Technicoat Evap. Coil, & Coil Guard
JM	Johnson UNT Controller, DFS, APS, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
JN	Johnson UNT Controller, DFS, APS & Technicoat Evap. & Cond Coils
JP	Johnson UNT Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Phase Monitor
JQ	Johnson UNT Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Coil Guard
JR	Johnson UNT Controller, DFS, APS, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
JS	Johnson UNT Controller, DFS, APS, SS Drain Pan
JT	Johnson UNT Controller, DFS, APS, SS Drain Pan, Phase Monitor, & Coil Guard
JU	Johnson UNT Controller, DFS, APS, SS Drain Pan, & Technicoat Cond Coils
JV	Johnson UNT Controller, DFS, APS, SS Drain Pan, & Technicoat Evap Coil
JW	Johnson UNT Controller, DFS, APS, SS Drain Pan, & Technicoat Evap and Cond Coils
JX	Johnson UNT Controller, DFS, APS, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils

Additional Options	
HA	Honeywell Excel 10 Controller with Dirty Filter Switch & Air Proving Switch
HB	Honeywell Excel 10 Controller, DFS, APS & Phase Monitor
HC	Honeywell Excel 10 Controller, DFS, APS & Coil Guard
HD	Honeywell Excel 10 Controller, DFS, APS, Phase Monitor, & Coil Guard
HE	Honeywell Excel 10 Controller, DFS, APS & Technicoat Cond. Coil
HF	Honeywell Excel 10 Controller, DFS, APS, Technicoat Cond. Coil, & Phase Monitor
HG	Honeywell Excel 10 Controller, DFS, APS, Technicoat Cond. Coil, & Coil Guard
HH	Honeywell Excel 10 Controller, DFS, APS, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
HJ	Honeywell Excel 10 Controller, DFS, APS & Technicoat Evap. Coil
HK	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. Coil, & Phase Monitor
HL	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. Coil, & Coil Guard
HM	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
HN	Honeywell Excel 10 Controller, DFS, APS & Technicoat Evap. & Cond Coils
HP	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Phase Monitor
HQ	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Coil Guard
HR	Honeywell Excel 10 Controller, DFS, APS, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
HS	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan
HT	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan, Phase Monitor, & Coil Guard
HU	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan, & Technicoat Cond Coils
HV	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan, & Technicoat Evap Coil
HW	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan, & Technicoat Evap and Cond Coils
HX	Honeywell Excel 10 Controller, DFS, APS, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils
WA	Intelli-Comfort w/ModLINC Controller
WB	Intelli-Comfort w/ModLINC Controller, & Phase Monitor
WC	Intelli-Comfort w/ModLINC Controller, & Coil Guard
WD	Intelli-Comfort w/ModLINC Controller, Phase Monitor, & Coil Guard
WE	Intelli-Comfort w/ModLINC Controller, & Technicoat Cond. Coil
WF	Intelli-Comfort w/ModLINC Controller, Technicoat Cond. Coil, & Phase Monitor
WG	Intelli-Comfort w/ModLINC Controller, Technicoat Cond. Coil, & Coil Guard
WH	Intelli-Comfort w/ModLINC Controller, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
WJ	Intelli-Comfort w/ModLINC Controller, & Technicoat Evap. Coil
WK	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. Coil, & Phase Monitor
WL	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. Coil, & Coil Guard
WM	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
WN	Intelli-Comfort w/ModLINC Controller, & Technicoat Evap. & Cond Coils
WP	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. & Cond Coils, & Phase Monitor
WQ	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. & Cond Coils, & Coil Guard
WR	Intelli-Comfort w/ModLINC Controller, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
WS	Intelli-Comfort w/ModLINC Controller, SS Drain Pan
WT	Intelli-Comfort w/ModLINC Controller, SS Drain Pan, Phase Monitor, & Coil Guard
WU	Intelli-Comfort w/ModLINC Controller, SS Drain Pan, & Technicoat Cond Coils
WV	Intelli-Comfort w/ModLINC Controller, SS Drain Pan, & Technicoat Evap Coil
WW	Intelli-Comfort w/ModLINC Controller, SS Drain Pan, & Technicoat Evap and Cond Coils
WX	Intelli-Comfort w/ModLINC Controller, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils
NA	Novar ETC-3 Controller with Dirty Filter Switch & Air Proving Switch
NB	Novar ETC-3 Controller, DFS, APS & Phase Monitor
NC	Novar ETC-3 Controller, DFS, APS & Coil Guard
ND	Novar ETC-3 Controller, DFS, APS, Phase Monitor, & Coil Guard
NE	Novar ETC-3 Controller, DFS, APS & Technicoat Cond. Coil
NF	Novar ETC-3 Controller, DFS, APS, Technicoat Cond. Coil, & Phase Monitor
NG	Novar ETC-3 Controller, DFS, APS, Technicoat Cond. Coil, & Coil Guard
NH	Novar ETC-3 Controller, DFS, APS, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
NJ	Novar ETC-3 Controller, DFS, APS & Technicoat Evap. Coil
NK	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. Coil, & Phase Monitor
NL	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. Coil, & Coil Guard
NM	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
NN	Novar ETC-3 Controller, DFS, APS & Technicoat Evap. & Cond Coils
NP	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Phase Monitor
NQ	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. & Cond Coils, & Coil Guard

Additional Options	
NR	Novar ETC-3 Controller, DFS, APS, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
NS	Novar ETC-3 Controller, DFS, APS, SS Drain Pan
NT	Novar ETC-3 Controller, DFS, APS, SS Drain Pan, Phase Monitor, & Coil Guard
NU	Novar ETC-3 Controller, DFS, APS, SS Drain Pan, & Technicoat Cond Coils
NV	Novar ETC-3 Controller, DFS, APS, SS Drain Pan, & Technicoat Evap Coil
NW	Novar ETC-3, DFS, APS, SS Drain Pan, & Technicoat Evap and Cond Coils
NX	Novar ETC-3 Controller, DFS, APS, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils
LA	Simplicity Intelli-Comfort Controller
LB	Simplicity Intelli-Comfort Controller, & Phase Monitor
LC	Simplicity Intelli-Comfort Controller, & Coil Guard
LD	Simplicity Intelli-Comfort Controller, Phase Monitor, & Coil Guard
LE	Simplicity Intelli-Comfort Controller, & Technicoat Cond. Coil
LF	Simplicity Intelli-Comfort Controller, Technicoat Cond. Coil, & Phase Monitor
LG	Simplicity Intelli-Comfort Controller, Technicoat Cond. Coil, & Coil Guard
LH	Simplicity Intelli-Comfort Controller, Technicoat Cond. Coil, Phase Monitor, & Coil Guard
LJ	Simplicity Intelli-Comfort Controller, & Technicoat Evap. Coil
LK	Simplicity Intelli-Comfort Controller, Technicoat Evap. Coil, & Phase Monitor
LL	Simplicity Intelli-Comfort Controller, Technicoat Evap. Coil, & Coil Guard
LM	Simplicity Intelli-Comfort Controller, Technicoat Evap. Coil, Phase Monitor, & Coil Guard
LN	Simplicity Intelli-Comfort Controller, & Technicoat Evap. & Cond Coils
LP	Simplicity Intelli-Comfort Controller, Technicoat Evap. & Cond Coils, & Phase Monitor
LQ	Simplicity Intelli-Comfort Controller, Technicoat Evap. & Cond Coils, & Coil Guard
LR	Simplicity Intelli-Comfort Controller, Technicoat Evap. & Cond Coils, Phase Monitor, & Coil Guard
LS	Simplicity Intelli-Comfort Controller, SS Drain Pan
LT	Simplicity Intelli-Comfort Controller, SS Drain Pan, Phase Monitor, & Coil Guard
LU	Simplicity Intelli-Comfort Controller, SS Drain Pan, & Technicoat Cond Coils
LV	Simplicity Intelli-Comfort Controller, SS Drain Pan, & Technicoat Evap Coil
LW	Simplicity Intelli-Comfort Controller, SS Drain Pan, & Technicoat Evap and Cond Coils
LX	Simplicity Intelli-Comfort Controller, SS Drain Pan, Phase Monitor, Coil Guard, & Technicoat Evap and Cond Coils
TA	Technicoat Condenser Coil
TB	Technicoat Condenser Coil & Phase Monitor
TC	Technicoat Condenser Coil & Coil Guard
TD	Technicoat Condenser Coil & Dirty Filter Switch
TE	Technicoat Condenser Coil, Phase Monitor, & Coil Guard
TF	Technicoat Condenser Coil, Phase Monitor, & Dirty Filter Switch
TG	Technicoat Condenser Coil, Coil Guard, & Dirty Filter Switch
TH	Technicoat Condenser Coil, Phase Monitor, Coil Guard, & Dirty Filter Switch
TJ	Technicoat Evaporator Coil
TK	Technicoat Evaporator Coil & Phase Monitor
TL	Technicoat Evaporator Coil & Coil Guard
TM	Technicoat Evaporator Coil & Dirty Filter Switch
TN	Technicoat Evaporator Coil, Phase Monitor, & Coil Guard
TP	Technicoat Evaporator Coil, Phase Monitor, & Dirty Filter Switch
TQ	Technicoat Evaporator Coil, Coil Guard, & Dirty Filter Switch
TR	Technicoat Evaporator Coil, Phase Monitor, Coil Guard, & Dirty Filter Switch
TS	Technicoat Evaporator & Condenser Coils
TT	Technicoat Evaporator & Condenser Coils & Phase Monitor
TU	Technicoat Evaporator & Condenser Coils & Coil Guard
TV	Technicoat Evaporator & Condenser Coils & Dirty Filter Switch
TW	Technicoat Evaporator & Condenser Coils, Phase Monitor, & Coil Guard
TX	Technicoat Evaporator & Condenser Coils, Phase Monitor, & Dirty Filter Switch
TY	Technicoat Evaporator & Condenser Coils, Coil Guard, & Dirty Filter Switch
TZ	Technicoat Evaporator & Condenser Coils, Phase Monitor, Coil Guard, & Dirty Filter Switch
T1	Technicoat Condenser & SS Drain Pan
T3	Technicoat Condenser Coil, SS Drain Pan, Phase Monitor, Coil Guard, & Dirty Filter Switch
T4	Technicoat Evaporator & SS Drain Pan
T6	Technicoat Evaporator Coil, SS Drain Pan, Phase Monitor, Coil Guard, & Dirty Filter Switch
T7	Technicoat Evaporator & Condenser Coils & SS Drain Pan
T9	Technicoat Evaporator & Condenser Coils, SS Drain Pan, Phase Monitor, Coil Guard, & Dirty Filter Switch

**TABLE 2: PHYSICAL DATA**

Component		Models				
		078	090	102	120	150
<b>Evaporator Blower</b>	Blower, Centrifugal (Dia. X Wd. in.)	15 x 15	15 x 15	15 x 15	15 x 15	15 x 15
	Motor, Standard (HP)	1-1/2	1-1/2	2	2	3
	Motor, Optional (HP)	2	2	3	3	5
<b>Evaporator Coil</b>	Rows	2	2	3	2	3
	Fins per Inch	15	15	15	15	15
	Height (in.)	30	32	24	40	40
	Face Area (ft. <sup>2</sup> each)	9.9	10.6	7.9	13.2	13.2
<b>Condenser Fan (2 per Unit)</b>	Propeller Dia. (in., each)	24	24	24	24	24
	Motor (HP, each)	1/3	1/3	3/4	3/4	3/4
	CFM, Nominal (each)	3400	3400	4400	4400	4400
<b>Condenser Coil (2 per unit)</b>	Rows (each)	1	1	1	1	2
	Fins per Inch	20	20	20	20	20
	Height (in. each)	24	28	36	44	44
	Face Area (ft. <sup>2</sup> each)	7.9	9.2	11.9	14.5	14.5
<b>Refrigerant Charge</b>	System 1 (lb./oz.)	4/6	4/12	5/0	6/12	10/12
	System 2 (lb./oz.)	4/0	4/6	5/4	6/12	11/0
<b>Compressors</b>	Quantity	2	2	2	2	2
	Type	Recip	Recip	Recip	Recip	Scroll
<b>Air Filters</b>	Size (Wd. x Ht. x Thickness in.)	25x20x2	25x20x2	25x20x2	25x20x2	25x20x2
	Number Per Unit	4	4	4	4	4

**TABLE 3: DM CAPACITY RATINGS**

Size (Tons)	Model	Cooling Capacities ARI Ratings*			CFM	Sound Rating (dB)†	Nominal Electric Heat Capacity‡ (kW)	Gas Heat Capacity				Gas Line Size (in. OD)
		MBH	EER	IPLV				Input (MBH)	Output (MBH)	Seasonal Efficiency (%)	Temp. Rise (°F)	
<b>078</b> (6-1/2)	Cooling Only	77	9.0	9.45	2600	84	-	-	-	-	-	-
	Electric Heat						9, 18, 24, 34	-	-	-	-	-
	Gas Heat						-	120	96	80	20-50	3/4
	Gas Heat						-	180	144	80	35-65	3/4
<b>090</b> (7-1/2)	Cooling Only	86	9.0	10.15	3000	84	-	-	-	-	-	-
	Electric Heat						9, 18, 24, 34	-	-	-	-	-
	Gas Heat						-	120	96	80	15-45	3/4
	Gas Heat						-	180	144	80	30-60	3/4
<b>102</b> (8-1/2)	Cooling Only	98	9.0	9.35	3000	90	-	-	-	-	-	-
	Electric Heat						9, 18, 24, 34	-	-	-	-	-
	Gas Heat						-	120	96	80	15-45	3/4
	Gas Heat						-	180	144	80	10-40	3/4
<b>120</b> (10)	Cooling Only	120	9.0	9.10	4000	90	-	-	-	-	-	-
	Electric Heat						9, 24, 34, 54	-	-	-	-	-
	Gas Heat						-	180	144	80	20-50	3/4
	Gas Heat						-	240	192	80	35-65	3/4
<b>150</b> (12-1/2)	Cooling Only	144	9.3	9.25	4500	90	-	-	-	-	-	-
	Electric Heat						9, 24, 34, 54	-	-	-	-	-
	Gas Heat						-	180	144	80	10-40	3/4
	Gas Heat						-	240	192	80	25-55	3/4

\* Rated at 95°F ambient 80°F dry bulb and 67°F wet bulb.

† Rated in accordance with ARI 270 standard.

‡ See Table 20.

**TABLE 4: UNIT VOLTAGE LIMITATIONS**

POWER RATING	MIN.	MAX.
<b>208/230-3-60</b>	187	252
<b>460-3-60</b>	432	504
<b>575-3-60</b>	540	630

**TABLE 5: COOLING CAPACITY 6-1/2 TON UNIT**

Air On Evap. Coil		Temperature of Air on Condenser Coil 85°F									Temperature of Air on Condenser Coil 95°F										
CFM	WB (°F)	Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)								Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							
				86	83	80	77	74	71	68	86			83	80	77	74	71	68		
1950	72	87	6.8	49	43	37	32	26	-	-	78	7.3	45	40	34	28	23	-	-		
	67	80	6.7	61	55	50	44	38	33	27	73	7.1	57	52	46	41	35	29	24		
	62	71	6.4	71	66	61	55	50	44	39	63	6.9	63	61	56	50	45	39	33		
2275	57	66	6.4	66	66	61	56	50	44	39	59	6.8	59	59	54	49	43	37	32		
	72	91	6.9	54	47	41	34	28	-	-	82	7.4	50	44	37	31	24	-	-		
	67	83	6.7	67	61	54	47	41	34	28	76	7.2	64	57	51	44	38	31	24		
2600	62	74	6.5	74	72	66	60	53	47	40	66	6.9	66	65	61	55	48	42	35		
	57	69	6.5	69	69	67	60	54	47	40	62	6.9	62	62	60	53	46	40	33		
	72	94	7.0	59	52	44	37	29	-	-	86	7.5	56	48	41	33	26	-	-		
2925	67	87	6.8	74	66	58	51	43	36	28	80	7.3	70	63	55	48	40	33	25		
	62	77	6.6	77	77	72	64	57	49	42	69	7.0	69	69	67	59	52	44	37		
	57	72	6.6	72	72	72	65	57	49	42	65	7.0	65	65	65	57	50	42	35		
3250	72	95	7.0	63	55	46	37	29	-	-	85	7.5	60	51	43	34	25	-	-		
	67	88	6.8	78	70	61	52	44	35	26	79	7.3	74	66	58	49	40	32	23		
	62	77	6.6	77	77	75	66	58	49	40	69	7.1	69	69	67	59	50	42	33		
3250	57	73	6.6	73	73	73	64	56	47	38	64	7.0	64	64	64	56	47	39	30		
	72	96	7.0	67	58	48	38	29	-	-	85	7.5	64	54	44	35	25	-	-		
	67	89	6.8	83	73	64	54	44	35	25	78	7.3	78	70	60	50	41	31	21		
3250	62	78	6.6	78	78	78	68	59	49	39	68	7.1	68	68	68	58	49	39	29		
	57	74	6.6	74	74	74	64	54	45	35	64	7.1	64	64	64	54	45	35	25		
	Temperature of Air on Condenser Coil 105°F									Temperature of Air on Condenser Coil 115°F											
1950	72	73	7.8	43	37	31	26	20	-	-	67	8.3	40	35	29	23	18	-	-		
	67	66	7.5	54	48	43	37	32	26	21	58	7.9	51	45	40	34	29	23	17		
	62	64	7.4	61	57	52	46	41	35	30	66	7.9	59	54	48	42	37	31	26		
2275	57	54	7.3	54	54	48	43	37	32	26	48	7.8	48	48	43	37	31	26	20		
	72	76	7.9	48	41	34	28	21	-	-	69	8.4	45	38	32	25	18	-	-		
	67	68	7.6	60	54	47	40	34	27	21	60	8.0	56	50	43	37	30	24	17		
2600	62	67	7.5	65	62	57	50	44	37	31	67	8.0	64	59	52	46	39	33	26		
	57	56	7.4	56	56	53	46	40	33	27	49	7.9	49	49	46	40	33	27	20		
	72	78	8.0	53	45	38	30	22	-	-	71	8.4	49	42	34	27	19	-	-		
2925	67	71	7.7	66	59	51	44	36	28	21	61	8.1	61	55	47	39	32	24	17		
	62	69	7.5	69	67	62	54	47	39	31	69	8.0	69	64	57	49	42	34	26		
	57	58	7.5	58	58	58	50	42	35	27	50	7.9	50	50	50	43	35	28	20		
3250	72	78	8.0	57	48	40	31	23	-	-	71	8.5	54	46	37	28	20	-	-		
	67	70	7.7	68	62	54	46	37	28	20	62	8.2	62	58	51	42	33	25	16		
	62	69	7.6	69	68	64	56	47	38	30	69	8.1	69	67	61	53	44	35	27		
3250	57	58	7.5	58	58	58	49	40	32	23	51	8.0	51	51	51	42	33	25	16		
	72	78	8.1	61	52	42	32	23	-	-	71	8.6	59	49	40	30	20	-	-		
	67	70	7.8	70	66	57	48	38	28	19	62	8.3	62	62	55	45	35	25	16		
3250	62	69	7.6	69	69	67	57	48	38	28	70	8.2	70	70	66	56	46	37	27		
	57	57	7.6	57	57	57	48	38	28	19	51	8.1	51	51	51	41	31	22	12		
	Temperature of Air on Condenser Coil 125°F									Temperature of Air on Condenser Coil 125°F											
1950	72	62	8.8	38	32	27	21	15	-	-	-	-	-	-	-	-	-	-	-		
	67	51	8.4	48	42	37	31	25	20	14	-	-	-	-	-	-	-	-	-		
	62	67	8.4	57	50	44	39	33	27	22	-	-	-	-	-	-	-	-	-		
2275	57	42	8.3	42	42	37	31	26	20	15	-	-	-	-	-	-	-	-	-		
	72	63	8.8	42	35	29	22	16	-	-	-	-	-	-	-	-	-	-	-		
	67	52	8.4	52	46	40	33	27	20	13	-	-	-	-	-	-	-	-	-		
2600	62	68	8.5	63	56	48	41	35	28	22	-	-	-	-	-	-	-	-	-		
	57	43	8.3	43	43	40	33	27	20	14	-	-	-	-	-	-	-	-	-		
	72	63	8.9	46	39	31	23	16	-	-	-	-	-	-	-	-	-	-	-		
2925	67	52	8.5	52	50	43	35	28	20	12	-	-	-	-	-	-	-	-	-		
	62	69	8.5	69	62	52	44	37	29	21	-	-	-	-	-	-	-	-	-		
	57	43	8.4	43	43	43	35	28	20	13	-	-	-	-	-	-	-	-	-		
3250	72	64	9.0	52	43	34	26	17	-	-	-	-	-	-	-	-	-	-	-		
	67	53	8.6	53	53	47	39	30	21	13	-	-	-	-	-	-	-	-	-		
	62	70	8.6	70	66	58	50	41	32	24	-	-	-	-	-	-	-	-	-		
3250	57	44	8.5	44	44	44	35	26	18	9	-	-	-	-	-	-	-	-	-		
	72	65	9.1	57	47	38	28	18	-	-	-	-	-	-	-	-	-	-	-		
	67	54	8.7	54	54	52	42	32	23	13	-	-	-	-	-	-	-	-	-		
3250	62	71	8.8	71	71	65	55	45	36	26	-	-	-	-	-	-	-	-	-		
	57	44	8.6	44	44	44	34	25	15	5	-	-	-	-	-	-	-	-	-		

\* These capacities are gross ratings. For net capacity, deduct air blower motor, MBH = 3.415 x kW. Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

† These ratings include condenser fan motors and the compressor motors but not the supply air blower motor.

**TABLE 6: COOLING CAPACITY 7-1/2 TON UNIT**

Air On Evap. Coil		Temperature of Air on Condenser Coil 85°F									Temperature of Air on Condenser Coil 95°F										
CFM	WB (°F)	Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)								Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							
				86	83	80	77	74	71	68	86			83	80	77	74	71	68		
2250	72	98	7.9	58	51	45	39	32	-	-	91	8.4	55	49	42	36	29	-	-		
	67	90	7.7	71	65	59	52	46	39	33	84	8.2	68	62	56	49	43	36	30		
	62	83	7.5	83	78	71	65	59	52	46	76	8.0	76	74	68	61	55	49	42		
2625	57	79	7.4	79	79	73	67	61	54	48	73	7.9	73	73	68	62	55	49	42		
	72	100	7.9	63	55	48	40	33	-	-	94	8.5	60	53	45	38	30	-	-		
	67	92	7.8	78	70	62	55	47	40	32	87	8.3	75	67	60	52	45	37	29		
3000	62	85	7.6	85	82	76	69	61	53	46	78	8.0	78	77	73	65	58	50	42		
	57	81	7.5	81	81	78	71	63	55	48	76	8.0	76	76	73	66	58	50	43		
	72	102	8.0	68	60	51	42	33	-	-	96	8.6	66	57	48	40	31	-	-		
3375	67	94	7.8	84	75	66	57	49	40	31	89	8.3	81	73	64	55	46	38	29		
	62	87	7.6	87	87	81	72	63	54	46	81	8.1	81	81	78	69	60	52	43		
	57	83	7.6	83	83	83	74	65	57	48	78	8.1	78	78	78	69	61	52	43		
3750	72	103	8.1	73	63	53	43	33	-	-	97	8.6	70	60	50	40	30	-	-		
	67	95	7.9	89	79	69	59	49	39	29	90	8.4	86	76	66	56	46	36	27		
	62	88	7.7	88	88	84	74	64	54	44	81	8.2	81	81	80	70	60	50	40		
3750	57	84	7.6	84	84	84	74	64	54	44	78	8.2	78	78	78	68	58	49	39		
	72	104	8.1	77	66	55	43	32	-	-	97	8.7	75	63	52	41	30	-	-		
	67	96	8.0	94	82	71	60	49	38	26	90	8.5	90	80	69	58	46	35	24		
62	88	7.7	88	88	87	76	64	53	42	81	8.3	81	81	81	70	59	48	36			
57	84	7.7	84	84	84	73	62	51	40	79	8.2	79	79	79	67	56	45	34			
<b>Temperature of Air on Condenser Coil 105°F</b>											<b>Temperature of Air on Condenser Coil 115°F</b>										
2250	72	85	8.9	52	46	39	33	27	-	-	79	9.5	49	43	37	30	24	-	-		
	67	77	8.7	65	59	52	46	39	33	27	69	9.2	62	55	49	42	36	30	23		
	62	70	8.5	70	69	62	56	50	43	37	63	9.0	63	63	57	51	44	38	31		
2625	57	67	8.5	67	67	61	55	49	42	36	61	9.0	61	61	55	48	42	36	29		
	72	87	9.0	58	50	43	35	27	-	-	81	9.6	55	47	40	32	25	-	-		
	67	79	8.8	71	64	56	49	41	34	26	71	9.2	68	61	53	46	38	30	23		
3000	62	72	8.5	72	71	68	60	52	45	37	65	9.1	65	65	62	55	47	39	32		
	57	69	8.5	69	69	66	59	51	44	36	63	9.1	63	63	60	52	45	37	30		
	72	90	9.1	63	55	46	37	28	-	-	84	9.7	61	52	43	34	26	-	-		
3375	67	82	8.8	78	69	61	52	43	35	26	74	9.3	74	66	58	49	40	31	23		
	62	74	8.6	74	74	73	64	55	46	38	67	9.1	67	67	67	59	50	41	32		
	57	72	8.6	72	72	72	63	54	45	37	65	9.2	65	65	65	56	47	39	30		
3750	72	90	9.2	68	58	48	38	28	-	-	84	9.7	65	55	45	35	25	-	-		
	67	82	8.9	80	73	63	53	43	33	24	74	9.4	74	70	60	50	40	30	20		
	62	74	8.7	74	74	74	64	54	44	34	68	9.2	68	68	68	58	48	38	28		
3750	57	72	8.7	72	72	72	62	52	42	32	65	9.2	65	65	65	55	45	35	25		
	72	91	9.3	72	61	50	39	27	-	-	84	9.8	70	58	47	36	25	-	-		
	67	82	9.0	82	77	66	55	44	32	21	74	9.5	74	74	63	52	41	30	18		
62	74	8.8	74	74	74	63	52	41	30	68	9.3	68	68	68	57	45	34	23			
57	72	8.8	72	72	72	61	50	38	27	65	9.3	65	65	65	54	43	32	20			
<b>Temperature of Air on Condenser Coil 125°F</b>																					
2250	72	73	10.0	47	40	34	27	21	-	-											
	67	62	9.6	58	52	45	39	33	26	20											
	62	57	9.5	57	57	52	45	39	32	26											
2625	57	55	9.5	55	55	48	42	36	29	23											
	72	75	10.1	52	45	37	30	22	-	-											
	67	64	9.7	64	58	50	42	35	27	20											
3000	62	59	9.6	59	59	57	49	42	34	27											
	57	56	9.6	56	56	53	46	38	31	23											
	72	78	10.2	58	49	41	32	23	-	-											
3375	67	66	9.8	66	63	54	46	37	28	19											
	62	61	9.7	61	61	61	53	45	36	27											
	57	58	9.7	58	58	58	49	41	32	23											
3750	72	78	10.3	63	53	43	33	23	-	-											
	67	66	9.9	66	66	57	47	37	27	17											
	62	61	9.8	61	61	61	52	42	32	22											
3750	57	58	9.8	58	58	58	48	38	28	18											
	72	78	10.4	67	56	45	34	22	-	-											
	67	66	10.0	66	66	60	49	38	27	15											
62	61	9.9	61	61	61	50	39	27	16												
57	58	9.9	58	58	58	47	36	25	14												

\* These capacities are gross ratings. For net capacity, deduct air blower motor, MBH = 3.415 x kW. Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

† These ratings include condenser fan motors and the compressor motors but not the supply air blower motor.



**TABLE 7: COOLING CAPACITY 8-1/2 TON UNIT**

Air On Evap. Coil		Temperature of Air on Condenser Coil 85°F									Temperature of Air on Condenser Coil 95°F										
CFM	WB (°F)	Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)								Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							
				86	83	80	77	74	71	68	86			83	80	77	74	71	68		
2550	72	113	9.4	66	59	52	45	37	-	-	105	10.0	62	54	47	40	33	-	-		
	67	105	9.2	82	75	67	60	53	45	38	96	9.8	78	70	63	56	48	41	34		
	62	93	9.0	93	90	83	76	68	61	54	85	9.5	85	85	77	70	63	56	48		
2975	57	90	8.9	90	90	84	77	69	62	55	83	9.5	83	83	76	69	61	54	47		
	72	118	9.5	73	65	56	47	39	-	-	109	10.1	68	60	51	43	34	-	-		
	67	109	9.3	90	81	72	64	55	47	38	100	9.9	86	77	69	60	51	43	34		
3400	62	96	9.0	96	95	89	81	72	64	55	88	9.6	88	88	84	76	67	59	50		
	57	94	9.0	94	94	91	82	73	65	56	86	9.5	86	86	83	74	66	57	48		
	72	122	9.5	80	70	60	50	40	-	-	113	10.2	75	65	55	46	36	-	-		
3825	67	113	9.3	98	88	78	68	58	48	38	103	9.9	94	84	74	64	54	44	34		
	62	100	9.1	100	100	96	86	76	66	56	91	9.7	91	91	91	81	71	61	51		
	57	97	9.0	97	97	97	87	77	67	57	89	9.6	89	89	89	79	70	60	50		
4250	72	123	9.6	86	74	63	52	41	-	-	115	10.2	81	70	59	47	36	-	-		
	67	114	9.4	104	93	82	71	59	48	37	105	10.0	100	90	78	67	56	44	33		
	62	101	9.1	101	101	99	88	76	65	54	93	9.7	93	93	93	81	70	59	48		
2550	57	98	9.1	98	98	98	87	76	64	53	91	9.6	91	91	91	80	68	57	46		
	72	125	9.6	92	79	66	54	41	-	-	117	10.2	87	75	62	49	37	-	-		
	67	115	9.4	111	99	86	73	61	48	35	107	10.0	107	95	83	70	57	45	32		
2975	62	102	9.2	102	102	102	89	77	64	51	94	9.7	94	94	94	82	69	56	44		
	57	99	9.1	99	99	99	87	74	61	49	93	9.7	93	93	93	80	67	55	42		
	Temperature of Air on Condenser Coil 105°F									Temperature of Air on Condenser Coil 115°F											
2550	72	98	10.6	58	51	44	36	29	-	-	91	11.3	55	48	40	33	26	-	-		
	67	87	10.3	74	66	59	52	44	37	30	78	10.9	70	62	55	48	40	33	26		
	62	77	10.1	77	77	70	63	55	48	41	70	10.6	70	69	62	55	48	40	33		
2975	57	76	10.1	76	76	68	61	54	47	39	69	10.7	69	68	61	54	46	39	32		
	72	101	10.7	65	56	48	39	31	-	-	94	11.4	62	53	45	36	27	-	-		
	67	90	10.4	81	73	65	56	47	39	30	81	11.0	76	69	61	52	43	35	26		
3400	62	80	10.1	80	80	76	68	59	51	42	72	10.7	72	72	68	60	51	43	34		
	57	79	10.2	79	78	75	66	58	49	41	71	10.8	71	71	67	58	50	41	33		
	72	105	10.8	72	62	52	42	32	-	-	97	11.5	68	59	49	39	29	-	-		
3825	67	93	10.5	88	80	70	60	50	40	30	83	11.1	83	76	66	56	46	36	27		
	62	83	10.2	83	83	83	73	63	53	43	75	10.8	75	75	75	65	55	45	35		
	57	81	10.2	81	81	81	71	62	52	42	73	10.9	73	73	73	63	53	44	34		
4250	72	107	10.9	78	66	55	44	32	-	-	99	11.5	74	63	51	40	29	-	-		
	67	95	10.5	92	85	74	63	52	40	29	84	11.1	84	81	70	59	48	36	25		
	62	84	10.3	84	84	84	73	62	50	39	76	10.9	76	76	76	65	53	42	31		
2550	57	83	10.3	83	83	83	71	60	49	38	74	10.9	74	74	74	63	52	41	29		
	72	109	10.9	83	71	58	45	33	-	-	100	11.6	80	67	54	42	29	-	-		
	67	96	10.6	96	91	78	66	53	40	28	86	11.2	86	86	74	61	49	36	23		
2975	62	86	10.3	86	86	86	73	60	48	35	77	10.9	77	77	77	65	52	39	27		
	57	84	10.3	84	84	84	71	59	46	33	76	11.0	76	76	76	63	50	38	25		
	Temperature of Air on Condenser Coil 125°F									Temperature of Air on Condenser Coil 125°F											
2550	72	84	11.9	52	44	37	30	22	-	-											
	67	69	11.4	66	58	51	44	36	29	22											
	62	63	11.2	63	62	54	47	40	33	25											
2975	57	62	11.3	62	61	53	46	39	31	24											
	72	87	12.0	58	50	41	33	24	-	-											
	67	71	11.5	71	65	57	48	39	31	22											
3400	62	65	11.3	65	64	61	52	43	35	26											
	57	63	11.4	63	63	59	51	42	33	25											
	72	89	12.1	65	55	45	35	25	-	-											
3825	67	73	11.6	73	72	62	52	42	33	23											
	62	67	11.4	67	67	67	57	47	37	27											
	57	65	11.5	65	65	65	55	45	35	26											
4250	72	90	12.2	70	59	48	37	25	-	-											
	67	74	11.7	74	74	66	55	43	32	21											
	62	68	11.5	68	68	68	56	45	34	22											
2550	57	66	11.6	66	66	66	55	44	32	21											
	72	92	12.3	76	63	51	38	25	-	-											
	67	75	11.8	75	75	70	57	44	32	19											
2975	62	69	11.6	69	69	69	56	43	31	18											
	57	67	11.7	67	67	67	55	42	29	17											

\* These capacities are gross ratings. For net capacity, deduct air blower motor, MBH = 3.415 x kW. Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

† These ratings include condenser fan motors and the compressor motors but not the supply air blower motor.

**TABLE 8: COOLING CAPACITY 10 TON UNIT**

Air On Evap. Coil		Temperature of Air on Condenser Coil 85°F									Temperature of Air on Condenser Coil 95°F									
CFM	WB (°F)	Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							
				86	83	80	77	74	71	68			86	83	80	77	74	71	68	
3000	72	132	11.0	76	68	59	50	42	-	-	125	11.7	74	65	57	48	40	-	-	
	67	124	10.7	96	87	79	70	62	53	45	116	11.4	93	84	75	67	58	50	41	
	62	116	10.5	115	106	98	89	81	72	64	106	11.1	106	100	91	82	74	65	57	
	57	110	10.3	110	109	101	92	83	75	66	106	11.1	106	103	95	86	78	69	61	
3500	72	135	11.1	83	73	63	53	43	-	-	129	11.8	82	72	62	52	41	-	-	
	67	127	10.8	104	94	84	74	64	54	44	120	11.5	102	92	82	72	62	52	42	
	62	119	10.6	118	114	105	95	84	74	64	110	11.2	110	106	99	89	79	69	58	
	57	112	10.4	112	112	108	98	87	77	67	109	11.2	109	108	103	93	83	73	63	
4000	72	138	11.2	91	79	67	56	44	-	-	133	12.0	90	78	67	55	43	-	-	
	67	130	10.9	113	101	90	78	66	55	43	124	11.7	112	100	89	77	65	54	42	
	62	121	10.7	121	121	111	100	88	76	65	113	11.3	113	113	107	95	84	72	60	
	57	115	10.5	115	115	115	103	91	80	68	113	11.3	113	113	111	100	88	76	65	
4500	72	141	11.3	98	85	71	58	45	-	-	135	12.0	96	83	70	56	43	-	-	
	67	132	11.0	122	108	95	82	69	55	42	126	11.7	119	106	92	79	66	53	39	
	62	124	10.7	124	124	118	105	92	78	65	115	11.4	115	115	112	98	85	72	58	
	57	117	10.5	117	117	117	104	90	77	64	115	11.4	115	115	114	101	88	74	61	
5000	72	144	11.3	105	90	75	60	45	-	-	138	12.1	102	87	72	58	43	-	-	
	67	135	11.0	130	116	101	86	71	56	41	128	11.8	126	111	96	81	67	52	37	
	62	126	10.8	126	126	125	110	95	80	65	117	11.5	117	117	116	101	86	71	57	
	57	119	10.6	119	119	119	105	90	75	60	117	11.5	117	117	117	102	87	72	57	
<b>Temperature of Air on Condenser Coil 105°F</b>											<b>Temperature of Air on Condenser Coil 115°F</b>									
3000	72	117	12.4	70	62	53	45	36	-	-	109	13.1	67	58	50	41	33	-	-	
	67	107	12.0	89	80	71	63	54	46	37	97	12.5	85	76	67	59	50	42	33	
	62	97	11.6	97	94	85	77	68	60	51	88	12.2	88	88	80	71	62	54	45	
	57	98	11.7	98	96	88	79	71	62	54	91	12.3	91	89	81	72	64	55	46	
3500	72	121	12.5	78	68	58	48	38	-	-	113	13.2	75	64	54	44	34	-	-	
	67	110	12.1	98	88	78	68	57	47	37	100	12.6	94	83	73	63	53	43	33	
	62	100	11.7	100	99	93	83	73	62	52	91	12.3	91	91	87	76	66	56	46	
	57	102	11.8	102	100	95	85	75	65	55	94	12.4	94	93	88	78	67	57	47	
4000	72	124	12.7	86	74	63	51	39	-	-	116	13.4	82	70	59	47	35	-	-	
	67	113	12.2	107	96	84	72	61	49	37	103	12.8	103	91	79	68	56	44	33	
	62	103	11.9	103	103	100	89	77	65	54	94	12.4	94	94	94	82	70	59	47	
	57	105	11.9	105	105	103	91	80	68	56	97	12.5	97	97	95	83	71	60	48	
4500	72	127	12.8	93	79	66	53	39	-	-	119	13.5	89	76	63	49	36	-	-	
	67	116	12.3	112	102	88	75	62	49	35	106	12.9	106	98	84	71	58	45	31	
	62	106	12.0	106	106	104	91	77	64	51	96	12.5	96	96	96	83	70	56	43	
	57	107	12.0	107	107	106	93	80	66	53	99	12.6	99	99	98	85	72	59	45	
5000	72	130	12.9	99	84	69	54	40	-	-	123	13.6	96	81	66	51	37	-	-	
	67	119	12.4	117	108	93	78	63	48	33	109	13.0	109	104	90	75	60	45	30	
	62	108	12.1	108	108	107	93	78	63	48	99	12.7	99	99	99	84	69	54	39	
	57	110	12.1	110	110	110	95	80	65	50	102	12.7	102	102	102	87	72	57	42	
<b>Temperature of Air on Condenser Coil 125°F</b>																				
3000	72	101	13.8	64	55	46	38	29	-	-										
	67	87	13.0	80	72	63	55	46	38	29										
	62	79	12.7	79	79	74	65	57	48	40										
	57	83	12.9	83	82	74	65	56	48	39										
3500	72	105	14.0	71	61	51	40	30	-	-										
	67	90	13.2	89	79	69	59	49	39	29										
	62	81	12.9	81	81	80	70	60	50	40										
	57	86	13.0	86	85	80	70	60	50	40										
4000	72	108	14.1	78	66	55	43	31	-	-										
	67	92	13.3	92	86	75	63	51	40	28										
	62	84	13.0	84	84	84	75	64	52	40										
	57	88	13.1	88	88	87	75	63	52	40										
4500	72	112	14.2	86	72	59	46	32	-	-										
	67	96	13.4	96	94	80	67	54	41	27										
	62	87	13.1	87	87	87	75	62	49	35										
	57	91	13.2	91	91	90	77	64	51	37										
5000	72	115	14.4	93	78	63	48	33	-	-										
	67	99	13.6	99	99	86	71	56	41	27										
	62	89	13.3	89	89	89	75	60	45	30										
	57	94	13.4	94	94	94	79	65	50	35										

\* These capacities are gross ratings. For net capacity, deduct air blower motor, MBH = 3.415 x kW. Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

† These ratings include condenser fan motors and the compressor motors but not the supply air blower motor.

**TABLE 9: COOLING CAPACITY 12-1/2 TON UNIT**

Air On Evap. Coil		Temperature of Air on Condenser Coil 85°F									Temperature of Air on Condenser Coil 95°F										
CFM	WB (°F)	Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)								Tot. Cap.* (MBH)	Tot. Input† (kW)	Sensible Capacity (MBH)* Return Dry Bulb (°F)							
				86	83	80	77	74	71	68	86			83	80	77	74	71	68		
3750	72	154	12.0	93	82	71	61	50	39	29	151	13.4	91	80	70	59	48	38	27		
	67	152	11.8	122	112	101	90	79	69	58	147	13.1	120	109	98	88	77	66	56		
	62	145	11.6	145	138	128	117	106	96	85	138	13.0	138	134	123	112	101	91	80		
4375	57	144	11.6	144	143	133	122	111	101	90	138	13.0	138	137	126	116	105	94	84		
	72	158	12.0	101	89	76	63	51	38	26	155	13.5	100	87	75	62	50	37	24		
	67	156	11.8	133	120	107	95	82	70	57	150	13.2	131	118	106	93	80	68	55		
5000	62	148	11.7	148	145	136	123	111	98	85	142	13.0	142	139	132	119	107	94	81		
	57	147	11.7	147	147	141	129	116	104	91	142	13.0	142	141	136	123	111	98	85		
	72	161	12.1	110	95	81	66	52	37	22	158	13.5	109	95	80	65	51	36	22		
5625	67	159	11.8	143	129	114	99	85	70	56	154	13.2	142	128	113	98	84	69	55		
	62	151	11.7	151	151	144	130	115	101	86	145	13.1	145	145	141	126	112	97	83		
	57	150	11.7	150	150	150	136	121	106	92	145	13.1	145	145	145	131	116	101	87		
6250	72	161	12.1	116	99	83	66	49	33	16	157	13.5	115	99	82	66	49	32	16		
	67	158	11.9	150	133	117	100	83	67	50	153	13.2	147	133	116	100	83	66	50		
	62	151	11.7	151	151	147	131	114	97	81	144	13.1	144	144	142	126	109	92	76		
6250	57	150	11.7	150	150	150	133	116	100	83	144	13.1	144	144	144	128	111	94	78		
	72	160	12.1	122	103	84	66	47	28	10	157	13.5	122	103	84	66	47	28	10		
	67	158	11.9	156	138	119	100	82	63	45	152	13.2	152	138	119	101	82	63	45		
62	150	11.7	150	150	150	132	113	94	76	143	13.1	143	143	143	125	106	88	69			
57	149	11.7	149	149	149	130	112	93	74	143	13.0	143	143	143	125	106	88	69			
<b>Temperature of Air on Condenser Coil 105°F</b>											<b>Temperature of Air on Condenser Coil 115°F</b>										
3750	72	144	15.1	88	77	66	56	45	34	24	138	16.7	85	74	63	53	42	31	21		
	67	139	14.7	117	106	96	85	74	63	53	131	16.2	114	103	93	82	71	61	50		
	62	130	14.5	130	126	115	104	94	83	72	122	16.0	122	118	107	97	86	75	65		
4375	57	130	14.5	130	128	117	106	96	85	74	122	16.1	122	118	108	97	86	75	65		
	72	148	15.1	98	85	72	60	47	34	22	142	16.8	95	82	70	57	44	32	19		
	67	143	14.8	129	117	104	91	79	66	53	135	16.4	127	115	102	89	77	64	51		
5000	62	134	14.6	134	131	125	113	100	87	75	126	16.1	126	124	118	106	93	80	68		
	57	134	14.6	134	132	127	114	102	89	77	126	16.2	126	124	118	106	93	81	68		
	72	152	15.2	107	93	78	63	49	34	20	146	16.9	105	91	76	61	47	32	18		
5625	67	147	14.9	141	127	112	98	83	68	54	139	16.5	139	126	111	97	82	68	53		
	62	137	14.6	137	137	135	121	106	91	77	129	16.2	129	129	129	115	100	85	71		
	57	137	14.7	137	137	137	123	108	93	79	129	16.3	129	129	129	115	100	86	71		
6250	72	151	15.3	113	96	80	63	47	30	13	144	17.0	111	94	77	61	44	28	11		
	67	145	14.9	142	131	115	98	82	65	48	137	16.6	137	130	113	97	80	64	47		
	62	136	14.7	136	136	135	118	102	85	68	127	16.3	127	127	127	111	94	78	61		
6250	57	136	14.7	136	136	136	119	103	86	69	127	16.4	127	127	127	111	94	78	61		
	72	149	15.3	119	100	82	63	44	26	7	142	17.0	116	97	79	60	42	23	4		
	67	144	14.9	144	136	117	99	80	61	43	135	16.6	135	134	115	97	78	59	41		
62	134	14.7	134	134	134	116	97	79	60	125	16.3	125	125	125	107	88	70	51			
57	135	14.7	135	135	135	116	97	79	60	126	16.4	126	126	126	107	88	70	51			
<b>Temperature of Air on Condenser Coil 125°F</b>											<b>Temperature of Air on Condenser Coil 135°F</b>										
3750	72	131	18.3	81	71	60	49	39	28	17	131	19.8	71	60	50	40	30	20	10		
	67	124	17.8	111	100	90	79	68	58	47	124	19.3	101	90	80	70	60	50	40		
	62	114	17.5	114	110	100	89	78	68	57	114	19.0	114	110	100	90	80	70	60		
4375	57	114	17.6	114	109	98	87	77	66	55	114	19.1	114	109	98	87	77	66	55		
	72	136	18.4	92	80	67	54	42	29	17	136	20.0	80	67	54	42	29	17	10		
	67	128	18.0	124	113	100	88	75	62	50	128	19.6	124	113	100	88	75	62	50		
5000	62	117	17.6	117	116	112	99	86	74	61	117	19.7	117	116	112	99	86	74	61		
	57	118	17.8	118	115	110	97	85	72	59	118	19.9	118	115	110	97	85	72	59		
	72	140	18.6	103	89	74	60	45	30	16	140	20.6	93	79	64	49	34	19	10		
5625	67	132	18.2	132	125	111	96	81	67	52	132	19.8	132	125	111	96	81	67	52		
	62	121	17.8	121	121	121	109	94	80	65	121	19.4	121	121	121	109	94	80	65		
	57	121	18.0	121	121	121	107	92	78	63	121	19.6	121	121	121	107	92	78	63		
6250	72	137	18.7	108	92	75	58	42	25	9	137	20.3	108	92	75	58	42	25	9		
	67	129	18.2	129	129	112	95	79	62	46	129	19.9	129	129	129	112	95	79	62	46	
	62	119	17.9	119	119	119	103	87	70	53	119	19.5	119	119	119	103	87	70	53		
6250	57	119	18.0	119	119	119	102	86	69	53	119	19.7	119	119	119	102	86	69	53		
	72	134	18.8	113	95	76	57	39	20	2	134	20.4	113	95	76	57	39	20	2		
	67	127	18.3	127	127	113	95	76	58	39	127	20.0	127	127	113	95	76	58	39		
62	117	18.0	117	117	117	98	79	61	42	117	19.6	117	117	117	98	79	61	42			
57	117	18.1	117	117	117	98	79	61	42	117	19.7	117	117	117	98	79	61	42			

\* These capacities are gross ratings. For net capacity, deduct air blower motor, MBH = 3.415 x kW. Refer to the appropriate Blower Performance Table for the kW of the supply air blower motor.

† These ratings include condenser fan motors and the compressor motors but not the supply air blower motor.

**TABLE 10: ELECTRICAL DATA DM078 (6-1/2 TON) STD EFFICIENCY W/O PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	1.5 HP	2 HP	FLA	FLA				1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP
	208	12.8	110.0	1.5	6.2	8.2	5.5				0.0	None	--	--	38.0	40.0	43.5	45.5
								2TP04520925	6.8	18.9	38.0	40.0	43.5	45.5	50	50	50	50
								2TP04521825	13.5	37.5	54.6	57.1	61.5	64.0	60	60	70	70
								2TP04522425	18	50.0	70.2	72.7	77.1	79.6	80	80	80	80
								2TP04523625	25.5	70.8	96.2	98.7	103.1	105.6	100	100	110	110
230	12.8	110.0	1.5	6.2	8.2	5.5	0.0	None	--	--	38.0	40.0	43.5	45.5	50	50	50	50
								2TP04520925	9	21.7	38.0	40.0	43.5	45.5	50	50	50	50
								2TP04521825	18	43.3	61.9	64.4	68.8	71.3	70	70	70	80
								2TP04522425	24	57.7	79.9	82.4	86.8	89.3	80	90	90	90
								2TP04523625	34	81.8	110.0	112.5	116.9	119.4	110	125	125	125
460	7.1	54.0	0.8	3.1	4.1	2.2	0.0	None	--	--	20.7	21.7	22.9	23.9	25	25	25	30
								2TP04520946	9	11.3	20.7	21.7	22.9	23.9	25	25	25	30
								2TP04521846	18	22.6	30.9	32.2	33.7	34.9	35	35	35	35
								2TP04522446	24	30.1	40	41.2	42.7	44	40	45	45	45
								2TP04523646	34	42.7	55	56.2	57.7	59	60	60	60	60
575	5.1	44.0	0.6	2.4	3.6	1.8	0.0	None	--	--	15.1	16.3	16.9	18.1	20	20	20	20
								2TP04520958	9	9.0	15.1	16.3	16.9	18.1	20	20	20	20
								2TP04521858	18	18.1	24.7	26.2	26.9	28.4	25	30	30	30
								2TP04522458	24	24.1	31.9	33.4	34.1	35.6	35	35	35	40
								2TP04523658	34	34.1	43.9	45.4	46.1	47.6	45	50	50	50

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 11: ELECTRICAL DATA DM078 (6-1/2 TON) STD EFFICIENCY WITH PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	1.5 HP	2 HP	FLA	FLA				1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP
	208	12.8	110.0	1.5	6.2	8.2	5.5				10.0	None	--	--	48.0	50.0	53.5	55.5
								2TP04520925	6.8	18.9	48.0	50.0	53.5	55.5	60	60	60	60
								2TP04521825	13.5	37.5	67.1	69.6	74.0	76.5	70	70	80	80
								2TP04522425	18	50.0	82.7	85.2	89.6	92.1	90	90	90	100
								2TP04523625	25.5	70.8	108.7	111.2	115.6	118.1	110	125	125	125
230	12.8	110.0	1.5	6.2	8.2	5.5	10.0	None	--	--	48.0	50.0	53.5	55.5	60	60	60	60
								2TP04520925	9	21.7	48.0	50.0	54.2	56.7	60	60	60	60
								2TP04521825	18	43.3	74.4	76.9	81.3	83.8	80	80	90	90
								2TP04522425	24	57.7	92.4	94.9	99.3	101.8	100	100	100	110
								2TP04523625	34	81.8	122.5	125.0	129.4	131.9	125	125	150	150
460	7.1	54.0	0.8	3.1	4.1	2.2	5.0	None	--	--	25.7	26.7	27.9	28.9	30	30	30	35
								2TP04520946	9	11.3	25.7	26.7	27.9	28.9	30	30	30	35
								2TP04521846	18	22.6	37.2	38.4	39.9	41.2	40	40	40	45
								2TP04522446	24	30.1	46.2	47.5	49	50.2	50	50	50	60
								2TP04523646	34	42.7	61.2	62.5	64	65.2	70	70	70	70
575	5.1	44.0	0.6	2.4	3.6	1.8	4.0	None	--	--	19.1	20.3	20.9	22.1	20	25	25	25
								2TP04520958	9	9.0	19.1	20.3	21.1	22.6	20	25	25	25
								2TP04521858	18	18.1	29.7	31.2	31.9	33.4	30	35	35	35
								2TP04522458	24	24.1	36.9	38.4	39.1	40.6	40	40	40	45
								2TP04523658	34	34.1	48.9	50.4	51.1	52.6	50	60	60	60

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 12: ELECTRICAL DATA DM090 (7-1/2 TON) STD EFFICIENCY W/O PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	1.5 HP	2 HP	FLA	FLA				1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP
	208	13.5	110.0	1.5	6.2	8.2	5.5				0.0	None	--	--	39.6	41.6	45.1	47.1
								2TP04520925	6.8	18.9	39.6	41.6	45.1	47.1	50	50	50	60
								2TP04521825	13.5	37.5	54.6	57.1	61.5	64.0	60	60	70	70
								2TP04522425	18	50.0	70.2	72.7	77.1	79.6	80	80	80	80
								2TP04523625	25.5	70.8	96.2	98.7	103.1	105.6	100	100	110	110
230	13.5	110.0	1.5	6.2	8.2	5.5	0.0	None	--	--	39.6	41.6	45.1	47.1	50	50	50	60
								2TP04520925	9	21.7	39.6	41.6	45.1	47.1	50	50	50	60
								2TP04521825	18	43.3	61.9	64.4	68.8	71.3	70	70	70	80
								2TP04522425	24	57.7	79.9	82.4	86.8	89.3	80	90	90	90
								2TP04523625	34	81.8	110.0	112.5	116.9	119.4	110	125	125	125
460	7.1	54.0	0.8	3.1	4.1	2.2	0.0	None	--	--	20.7	21.7	22.9	23.9	25	25	25	30
								2TP04520946	9	11.3	20.7	21.7	22.9	23.9	25	25	25	30
								2TP04521846	18	22.6	30.9	32.2	33.7	34.9	35	35	35	35
								2TP04522446	24	30.1	40	41.2	42.7	44	40	45	45	45
								2TP04523646	34	42.7	55	56.2	57.7	59	60	60	60	60
575	5.4	44.0	0.6	2.4	3.6	1.8	0.0	None	--	--	15.8	17	17.6	18.8	20	20	20	20
								2TP04520958	9	9.0	15.8	17	17.6	18.8	20	20	20	20
								2TP04521858	18	18.1	24.7	26.2	26.9	28.4	25	30	30	30
								2TP04522458	24	24.1	31.9	33.4	34.1	35.6	35	35	35	40
								2TP04523658	34	34.1	43.9	45.4	46.1	47.6	45	50	50	50

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 13: ELECTRICAL DATA DM090 (7-1/2 TON) STD EFFICIENCY WITH PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	1.5 HP	2 HP	FLA	FLA				1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP	1.5 HP	2 HP
	208	13.5	110.0	1.5	6.2	8.2	5.5				10.0	None	--	--	49.6	51.6	55.1	57.1
								2TP04520925	6.8	18.9	49.6	51.6	55.1	57.1	60	60	60	70
								2TP04521825	13.5	37.5	67.1	69.6	74.0	76.5	70	70	80	80
								2TP04522425	18	50.0	82.7	85.2	89.6	92.1	90	90	90	100
								2TP04523625	25.5	70.8	108.7	111.2	115.6	118.1	110	125	125	125
230	13.5	110.0	1.5	6.2	8.2	5.5	10.0	None	--	--	49.6	51.6	55.1	57.1	60	60	60	70
								2TP04520925	9	21.7	49.6	51.6	55.1	57.1	60	60	60	70
								2TP04521825	18	43.3	74.4	76.9	81.3	83.8	80	80	90	90
								2TP04522425	24	57.7	92.4	94.9	99.3	101.8	100	100	100	110
								2TP04523625	34	81.8	122.5	125.0	129.4	131.9	125	125	150	150
460	7.1	54.0	0.8	3.1	4.1	2.2	5.0	None	--	--	25.7	26.7	27.9	28.9	30	30	30	35
								2TP04520946	9	11.3	25.7	26.7	27.9	28.9	30	30	30	35
								2TP04521846	18	22.6	37.2	38.4	39.9	41.2	40	40	40	45
								2TP04522446	24	30.1	46.2	47.5	49	50.2	50	50	50	60
								2TP04523646	34	42.7	61.2	62.5	64	65.2	70	70	70	70
575	5.4	44.0	0.6	2.4	3.6	1.8	4.0	None	--	--	19.8	21	21.6	22.8	25	25	25	25
								2TP04520958	9	9.0	19.8	21	21.6	22.8	25	25	25	25
								2TP04521858	18	18.1	29.7	31.2	31.9	33.4	30	35	35	35
								2TP04522458	24	24.1	36.9	38.4	39.1	40.6	40	40	40	45
								2TP04523658	34	34.1	48.9	50.4	51.1	52.6	50	60	60	60

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 14: ELECTRICAL DATA DM102 (8-1/2 TON) STD EFFICIENCY W/O PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	2 HP	3 HP	FLA	FLA				2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP
208	16.0	137.0	3.5	8.2	10.9	5.5	0.0	None	--	--	51.2	53.9	56.7	59.4	60	60	70	70
								2TP04520925	6.8	18.9	51.2	53.9	56.7	59.4	60	60	70	70
								2TP04521825	13.5	37.5	57.1	60.5	64.0	67.3	60	70	70	70
								2TP04522425	18	50.0	72.7	76.1	79.6	83.0	80	80	80	90
								2TP04523625	25.5	70.8	98.7	102.1	105.6	109.0	100	110	110	110
230	16.0	137.0	3.5	8.2	10.9	5.5	0.0	None	--	--	51.2	53.9	56.7	59.4	60	60	70	70
								2TP04520925	9	21.7	51.2	53.9	56.7	59.4	60	60	70	70
								2TP04521825	18	43.3	64.4	67.8	71.3	74.6	70	70	80	80
								2TP04522425	24	57.7	82.4	85.8	89.3	92.7	90	90	90	100
								2TP04523625	34	81.8	112.5	115.9	119.4	122.7	125	125	125	125
460	8.3	69.0	1.6	4.1	5.3	2.2	0.0	None	--	--	26	27.2	28.2	29.4	30	35	35	35
								2TP04520946	9	11.3	26	27.2	28.2	29.4	30	35	35	35
								2TP04521846	18	22.6	32.2	33.7	34.9	36.4	35	35	35	40
								2TP04522446	24	30.1	41.2	42.7	44	45.5	45	45	45	50
								2TP04523646	34	42.7	56.2	57.7	59	60.5	60	60	60	70
575	6.4	58.0	1.3	3.6	4.1	1.8	0.0	None	--	--	20.6	21.1	22.4	22.9	25	25	25	25
								2TP04520958	9	9.0	20.6	21.1	22.4	22.9	25	25	25	25
								2TP04521858	18	18.1	26.2	26.8	28.4	29	30	30	30	30
								2TP04522458	24	24.1	33.4	34	35.6	36.2	35	35	40	40
								2TP04523658	34	34.1	45.4	46	47.6	48.3	50	50	50	50

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 15: ELECTRICAL DATA DM102 (8-1/2 TON) STD EFFICIENCY WITH PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)	
	RLA ea.	LRA ea.	FLA ea.	2 HP	3 HP	FLA	FLA				2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP
208	16.0	137.0	3.5	8.2	10.9	5.5	10.0	None	--	--	61.2	63.9	66.7	69.4	70	70	80	80
								2TP04520925	6.8	18.9	61.2	63.9	66.7	69.4	70	70	80	80
								2TP04521825	13.5	37.5	69.6	73.0	76.5	79.8	70	80	80	80
								2TP04522425	18	50.0	85.2	88.6	92.1	95.5	90	90	100	100
								2TP04523625	25.5	70.8	111.2	114.6	118.1	121.5	125	125	125	125
230	16.0	137.0	3.5	8.2	10.9	5.5	10.0	None	--	--	61.2	63.9	66.7	69.4	70	70	80	80
								2TP04520925	9	21.7	61.2	63.9	66.7	69.4	70	70	80	80
								2TP04521825	18	43.3	76.9	80.3	83.8	87.1	80	90	90	90
								2TP04522425	24	57.7	94.9	98.3	101.8	105.2	100	100	110	110
								2TP04523625	34	81.8	125.0	128.4	131.9	135.2	125	150	150	150
460	8.3	69.0	1.6	4.1	5.3	2.2	5.0	None	--	--	31	32.2	33.2	34.4	35	40	40	40
								2TP04520946	9	11.3	31	32.2	33.2	34.4	35	40	40	40
								2TP04521846	18	22.6	38.4	39.9	41.2	42.7	40	40	45	45
								2TP04522446	24	30.1	47.5	49	50.2	51.7	50	50	60	60
								2TP04523646	34	42.7	62.5	64	65.2	66.7	70	70	70	70
575	6.4	58.0	1.3	3.6	4.1	1.8	4.0	None	--	--	24.6	25.1	26.4	26.9	30	30	30	30
								2TP04520958	9	9.0	24.6	25.1	26.4	26.9	30	30	30	30
								2TP04521858	18	18.1	31.2	31.8	33.4	34	35	35	35	35
								2TP04522458	24	24.1	38.4	39	40.6	41.2	40	40	45	45
								2TP04523658	34	34.1	50.4	51	52.6	53.3	60	60	60	60

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 16: ELECTRICAL DATA DM120 (10 TON) STD EFFICIENCY W/O PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)			
	RLA ea.	LRA ea.	FLA ea.	2 HP	3 HP	FLA	FLA				2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP
208	16.3	150.0	3.5	8.2	10.9	5.5	0.0	None	--	--	51.9	54.6	57.4	60.1	60	70	70	70		
								2TP04521825	13.5	37.5	57.1	60.5	64.0	67.3	60	70	70	70	70	70
								2TP04522425	18	50.0	72.7	76.1	79.6	83.0	80	80	80	80	80	90
								2TP04523625	25.5	70.8	98.7	102.1	105.6	109.0	100	110	110	110	110	110
								2TP04525425	40.6	112.7	151.1	154.5	158.0	161.4	175	175	175	175	175	175
230	16.3	150.0	3.5	8.2	10.9	5.5	0.0	None	--	--	51.9	54.6	57.4	60.1	60	70	70	70		
								2TP04521825	18	43.3	64.4	67.8	71.3	74.6	70	70	70	80	80	
								2TP04522425	24	57.7	82.4	85.8	89.3	92.7	90	90	90	90	100	
								2TP04523625	34	81.8	112.5	115.9	119.4	122.7	125	125	125	125	125	
								2TP04525425	54	129.9	140.2	143.5	147.0	150.4	150	175	175	175	175	
460	11.5	75.0	1.6	4.1	5.3	2.2	0.0	None	--	--	33.2	34.4	35.4	36.6	40	45	45	45		
								2TP04521846	18	22.6	33.2	34.4	35.4	36.6	40	45	45	45	45	
								2TP04522446	24	30.1	41.2	42.7	44	45.5	45	45	45	45	50	
								2TP04523646	34	42.7	56.2	57.7	59	60.5	60	60	60	60	70	
								2TP04525446	54	67.8	70.1	71.6	72.8	74.3	80	80	80	80	80	
575	7.1	62.0	1.3	3.6	4.1	1.8	0.0	None	--	--	22.2	22.7	24	24.5	25	25	30	30		
								2TP04521858	18	18.1	26.2	26.8	28.4	29	30	30	30	30	30	
								2TP04522458	24	24.1	33.4	34	35.6	36.2	35	35	40	40		
								2TP04523658	34	34.1	45.4	46	47.6	48.3	50	50	50	50		
								2TP04525458	54	54.2	56.5	57.1	58.7	59.3	70	70	70	70		

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 17: ELECTRICAL DATA DM120 (10 TON) STD EFFICIENCY WITH PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse* Size w/Power Exhaust (Amps)			
	RLA ea.	LRA ea.	FLA ea.	2 HP	3 HP	FLA	FLA				2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP	2 HP	3 HP
208	16.3	150.0	3.5	8.2	10.9	5.5	10.0	None	--	--	61.9	64.6	67.4	70.1	70	80	80	80		
								2TP04521825	13.5	37.5	69.6	73.0	76.5	79.8	70	80	80	80	80	
								2TP04522425	18	50.0	85.2	88.6	92.1	95.5	90	90	100	100		
								2TP04523625	25.5	70.8	111.2	114.6	118.1	121.5	125	125	125	125		
								2TP04525425	40.6	112.7	163.6	167.0	170.5	173.9	175	175	175	175		
230	16.3	150.0	3.5	8.2	10.9	5.5	10.0	None	--	--	61.9	64.6	67.4	70.1	70	80	80	80		
								2TP04521825	18	43.3	76.9	80.3	83.8	87.1	80	90	90	90		
								2TP04522425	24	57.7	94.9	98.3	101.8	105.2	100	100	110	110		
								2TP04523625	34	81.8	125.0	128.4	131.9	135.2	125	150	150	150		
								2TP04525425	54	129.9	152.7	156.0	159.5	162.9	175	175	175	175		
460	11.5	75.0	1.6	4.1	5.3	2.2	5.0	None	--	--	38.2	39.4	40.4	41.6	45	50	50	50		
								2TP04521846	18	22.6	38.4	39.9	41.2	42.7	45	50	50	50		
								2TP04522446	24	30.1	47.5	49	50.2	51.7	50	50	60	60		
								2TP04523646	34	42.7	62.5	64	65.2	66.7	70	70	70	70		
								2TP04525446	54	67.8	76.3	77.8	79.1	80.6	90	90	90	90		
575	7.1	62.0	1.3	3.6	4.1	1.8	4.0	None	--	--	26.2	26.7	28	28.5	30	30	35	35		
								2TP04521858	18	18.1	31.2	31.8	33.4	34	35	35	35	35		
								2TP04522458	24	24.1	38.4	39	40.6	41.2	40	40	45	45		
								2TP04523658	34	34.1	50.4	51	52.6	53.3	60	60	60	60		
								2TP04525458	54	54.2	61.5	62.1	63.7	64.3	70	70	70	70		

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 18: ELECTRICAL DATA DM150 (12-1/2 TON) STD EFFICIENCY W/O PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse Size w/Power			
	RLA	LRA	FLA	3	5	FLA	FLA				3	5	3	5	3	5	3	5	3	5
	ea.	ea.	ea.	HP	HP						HP	HP	HP	HP	HP	HP	HP	HP	HP	HP
208	20.0	146.0	3.5	10.9	16.1	5.5	0.0	None	--	--	62.9	68.1	68.4	73.6	80	80	80	90		
								2TP04521825	13.5	37.5	62.9	68.1	68.4	73.8	80	80	80	90		
								2TP04522425	18	50.0	76.1	82.6	83.0	89.5	80	90	90	90		
								2TP04523625	25.5	70.8	102.1	108.6	109.0	115.5	110	110	110	125		
								2TP04525425	40.6	112.7	154.5	161.0	161.4	167.9	175	175	175	175		
230	20.0	146.0	3.5	10.9	16.1	5.5	0.0	None	--	--	62.9	68.1	68.4	73.6	80	80	80	90		
								2TP04521825	18	43.3	67.8	74.3	74.6	81.1	80	80	80	90		
								2TP04522425	24	57.7	85.8	92.3	92.7	99.2	90	100	100	100		
								2TP04523625	34	81.8	115.9	122.4	122.7	129.2	125	125	125	150		
								2TP04525425	54	129.9	143.5	150.0	150.4	156.9	175	175	175	175		
460	8.4	73.0	1.6	5.3	8.1	2.2	0.0	None	--	--	27.4	30.2	29.6	32.4	35	35	35	40		
								2TP04521846	18	22.6	33.7	37.2	36.4	39.9	35	40	40	40		
								2TP04522446	24	30.1	42.7	46.2	45.5	49	45	50	50	50		
								2TP04523646	34	42.7	57.7	61.2	60.5	64	60	70	70	70		
								2TP04525446	54	67.8	71.6	75.1	74.3	77.8	80	90	80	90		
575	6.7	60.0	1.3	4.1	6.0	1.8	0.0	None	--	--	21.8	23.7	23.6	25.5	25	30	30	30		
								2TP04521858	18	18.1	26.8	29.2	29	31.4	30	30	30	35		
								2TP04522458	24	24.1	34	36.4	36.2	38.6	35	40	40	40		
								2TP04523658	34	34.1	46	48.4	48.3	50.6	50	50	50	60		
								2TP04525458	54	54.2	57.1	59.5	59.3	61.7	70	70	70	70		

\* Maximum HACR breaker of the same AMP size is applicable.

**TABLE 19: ELECTRICAL DATA DM150 (12-1/2 TON) STD EFFICIENCY W/PWRD CONVENIENCE OUTLET**

Voltage	Compressors		OD Fan Motors	Supply Blower Motor FLA		Pwr Exh Motor	Pwr Conv Outlet	Electric Heater Model No.	Actual KW	Heater Amps	Min. Circuit Ampacity (Amps)		MCA w/Power Exhaust (Amps)		Max Fuse* Size (Amps)		Max Fuse Size w/Power			
	RLA	LRA	FLA	3	5	FLA	FLA				3	5	3	5	3	5	3	5	3	5
	ea.	ea.	ea.	HP	HP						HP	HP	HP	HP	HP	HP	HP	HP	HP	HP
208	20.0	146.0	3.5	10.9	16.1	5.5	10.0	None	--	--	72.9	78.1	78.4	83.6	90	90	90	100		
								2TP04521825	13.5	37.5	73.0	79.5	79.8	86.3	90	90	90	100		
								2TP04522425	18	50.0	88.6	95.1	95.5	102.0	90	100	100	110		
								2TP04523625	25.5	70.8	114.6	121.1	121.5	128.0	125	125	125	150		
								2TP04525425	40.6	112.7	167.0	173.5	173.9	180.4	175	175	175	200		
230	20.0	146.0	3.5	10.9	16.1	5.5	10.0	None	--	--	72.9	78.1	78.4	83.6	90	90	90	100		
								2TP04521825	18	43.3	80.3	86.8	87.1	93.6	90	90	90	100		
								2TP04522425	24	57.7	98.3	104.8	105.2	111.7	100	110	110	125		
								2TP04523625	34	81.8	128.4	134.9	135.2	141.7	150	150	150	150		
								2TP04525425	54	129.9	156.0	162.5	162.9	169.4	175	175	175	175		
460	8.4	73.0	1.6	5.3	8.1	2.2	5.0	None	--	--	32.4	35.2	34.6	37.4	40	40	40	45		
								2TP04521846	18	22.6	39.9	43.4	42.7	46.2	40	45	45	50		
								2TP04522446	24	30.1	49	52.5	51.7	55.2	50	60	60	60		
								2TP04523646	34	42.7	64	67.5	66.7	70.2	70	70	70	80		
								2TP04525446	54	67.8	77.8	81.3	80.6	84.1	90	90	90	90		
575	6.7	60.0	1.3	4.1	6.0	1.8	4.0	None	--	--	25.8	27.7	27.6	29.5	30	30	30	35		
								2TP04521858	18	18.1	31.8	34.2	34	36.4	35	35	35	40		
								2TP04522458	24	24.1	39	41.4	41.2	43.6	40	45	45	45		
								2TP04523658	34	34.1	51	53.4	53.3	55.6	60	60	60	60		
								2TP04525458	54	54.2	62.1	64.5	64.3	66.7	70	70	70	70		

\* Maximum HACR breaker of the same AMP size is applicable.

**NOTES FOR TABLE 21 THROUGH TABLE 30:**

- Blower performance includes dry coil and 2" throwaway filters.
- Blower performance for gas heat includes the maximum number of heat tubes available for each tonnage.
- ESP (External Static Pressure) given is that available for the supply and return air duct system. All internal resistances have been deducted from the total static pressure of the blower.

**TABLE 20: ELECTRIC HEAT MULTIPLIERS**

VOLTAGE		kW Cap. Multiplier
NOMINAL	RATING	
240	208	0.75
	230	0.92
480	460	0.92
600	575	0.92

**NOTE:** Electric heaters are rated at nominal voltage. Use this table to determine the electric heat capacity for heaters supplied at lower voltages.



**TABLE 21: BLOWER PERFORMANCE 6-1/2 TON SIDE DUCT**

CFM	External Static Pressure																										
	0.2			0.4			0.6			0.8			1.0			1.2			1.4			1.6			1.8		
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts
1900	687	0.69	641	0.81	758	839	0.95	884	893	1.18	1097	957	1.34	1252	1013	1.42	1324	1062	1.59	1484							
2000	697	0.72	676	0.84	782	846	1.01	940	900	1.22	1137	963	1.39	1299	1019	1.48	1377	1067	1.65	1541							
2100	707	0.76	712	0.87	810	854	1.07	997	907	1.26	1179	970	1.44	1346	1024	1.53	1430	1073	1.71	1599							
2200	717	0.80	750	0.90	843	861	1.13	1055	913	1.31	1223	976	1.50	1395	1030	1.59	1485	1078	1.78	1656							
2300	727	0.85	790	0.94	880	869	1.19	1113	920	1.36	1269	983	1.55	1444	1035	1.65	1541	1083	1.84	1713							
2400	736	0.89	832	0.99	922	876	1.26	1172	927	1.41	1318	989	1.60	1493	1041	1.71	1597	1088	1.90	1770							
2500	746	0.94	877	1.04	968	884	1.32	1232	934	1.47	1369	996	1.66	1544	1046	1.78	1655	1094	1.96	1827							
2600	756	0.99	923	1.09	1019	891	1.39	1292	940	1.53	1423	1002	1.71	1595	1051	1.84	1713	1099	2.02	1884							
2700	766	1.04	971	1.15	1074	899	1.45	1353	947	1.59	1479	1008	1.77	1647	1057	1.90	1773	1104	2.08	1941							
2800	776	1.10	1022	1.22	1133	906	1.52	1414	954	1.65	1537	1015	1.82	1700	1062	1.97	1833	1109	2.14	1999							
2900	786	1.15	1074	1.28	1197	914	1.58	1476	960	1.71	1597	1021	1.88	1753	1068	2.03	1894	1113	2.19	2056							
3000	795	1.21	1129	1.36	1266	921	1.65	1539	967	1.78	1660	1028	1.94	1807	1073	2.10	1956	1117	2.24	2113							
3100	805	1.27	1185	1.44	1339	929	1.72	1602	974	1.85	1725	1034	2.00	1862	1078	2.11	2008	1121	2.29	2170							
3200	815	1.33	1244	1.52	1417	936	1.79	1666	981	1.92	1793	1041	2.06	1918	1083	2.12	2063	1125	2.34	2227							
3300	825	1.40	1305	1.61	1499	944	1.86	1731	987	2.00	1862	1047	2.12	1974	1088	2.13	2118	1129	2.39	2284							

High Horsepower Option Required

**TABLE 22: BLOWER PERFORMANCE 7-1/2 TON SIDE DUCT**

CFM	External Static Pressure																				
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8				
	RPM	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	
2200	697	0.85	794	777	0.90	843	851	1.04	969	910	1.32	1226	978	1.50	1395	1030	1.59	1485	1078	1.78	1656
2300	709	0.87	810	787	0.94	873	859	1.10	1025	917	1.36	1270	984	1.55	1444	1035	1.65	1541	1083	1.84	1713
2400	720	0.89	832	797	0.97	908	868	1.16	1082	924	1.41	1317	990	1.60	1494	1041	1.71	1597	1088	1.90	1770
2500	646	0.74	689	732	0.92	860	807	1.02	949	832	1.47	1367	996	1.66	1544	1046	1.78	1655	1094	1.96	1827
2600	662	0.78	725	744	0.96	893	816	1.07	996	884	1.29	1203	939	1.52	1419	1003	1.71	1595	1051	1.84	1713
2700	677	0.82	766	755	1.00	932	826	1.12	1047	893	1.36	1267	946	1.58	1475	1009	1.77	1647	1057	1.90	1773
2800	638	0.71	666	692	0.87	813	767	1.05	976	836	1.18	1104	901	1.43	1333	954	1.64	1533	1015	1.82	1699
2900	654	0.78	724	707	0.93	866	779	1.10	1025	846	1.25	1167	909	1.50	1401	961	1.71	1594	1021	1.88	1753
3000	670	0.84	787	722	0.99	924	791	1.16	1081	856	1.33	1235	918	1.58	1471	968	1.78	1659	1027	1.94	1807
3100	686	0.92	855	738	1.06	987	802	1.22	1141	866	1.40	1309	926	1.66	1543	976	1.85	1726	1034	2.00	1862
3200	702	1.00	929	753	1.13	1056	814	1.30	1208	875	1.49	1388	934	1.74	1618	983	1.93	1795	1040	2.06	1918
3300	718	1.08	1009	768	1.21	1131	826	1.37	1280	885	1.58	1472	943	1.82	1694	990	2.00	1868	1046	2.12	1975
3400	734	1.17	1094	783	1.30	1211	837	1.46	1357	895	1.68	1562	951	1.90	1773	998	2.09	1944	1052	2.18	2032
3500	750	1.27	1185	799	1.39	1297	849	1.54	1440	905	1.78	1658	959	1.99	1854	1005	2.17	2022	1058	2.24	2090
3600	766	1.37	1281	814	1.49	1388	861	1.64	1528	915	1.89	1759	968	2.08	1937	1012	2.26	2104	1065	2.31	2149
3700	782	1.48	1383	829	1.59	1485	872	1.74	1622	925	2.00	1865	976	2.17	2022	1012	2.26	2104	1065	2.31	2149
3800	798	1.60	1490	844	1.70	1587	884	1.85	1721	935	2.12	1977	984	2.26	2109	1012	2.26	2104	1065	2.31	2149

High Horsepower Option Required

**TABLE 23: BLOWER PERFORMANCE 8-1/2 TON SIDE DUCT**

CFM	External Static Pressure																				
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8				
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts			
2600	703	1.07	995	758	1.10	1023	831	1.26	1179	887.46	1.40	1302	947.16	1.57	1464	1003.3	1.72	1601	1080	1.89	1758
2700	716	1.09	1019	771	1.15	1072	841	1.31	1221	896.84	1.46	1359	955.17	1.63	1517	1010	1.78	1662	1083	1.97	1840
2800	729	1.12	1048	783	1.21	1125	851	1.36	1268	906.22	1.52	1419	963.18	1.69	1574	1016.7	1.85	1726	1086	2.06	1922
2900	741	1.16	1083	795	1.27	1181	861	1.42	1320	915.6	1.59	1482	971.19	1.75	1634	1023.4	1.92	1792	1090	2.15	2006
3000	754	1.21	1124	807	1.33	1241	871	1.48	1377	924.98	1.66	1549	979.2	1.82	1698	1030	2.00	1861	1093	2.24	2091
3100	767	1.26	1170	820	1.40	1305	882	1.54	1438	934.36	1.74	1618	987.21	1.89	1765	1036.7	2.07	1933	1097	2.34	2178
3200	780	1.31	1223	832	1.47	1371	892	1.61	1505	943.74	1.81	1691	995.22	1.97	1836	1043.4	2.15	2007	1100	2.43	2266
3300	792	1.37	1281	844	1.55	1442	902	1.69	1576	953.12	1.89	1766	1003.2	2.05	1910	1050.1	2.24	2084	1104	2.53	2356
3400	805	1.44	1344	856	1.63	1516	912	1.77	1652	962.5	1.98	1845	1011.2	2.13	1987	1056.8	2.32	2164	1107	2.62	2446
3500	818	1.52	1414	869	1.71	1593	922	1.86	1733	971.88	2.07	1927	1019.3	2.22	2068	1063.5	2.41	2246	1110	2.72	2539
3600	831	1.60	1489	881	1.80	1674	933	1.95	1819	981.26	2.16	2012	1027.3	2.31	2152	1070.2	2.50	2331	1114	2.82	2632
3700	843	1.68	1569	893	1.89	1758	943	2.05	1910	990.64	2.25	2100	1035.3	2.40	2239	1076.9	2.59	2419	1117	2.93	2728
3800	856	1.78	1656	906	1.98	1846	953	2.15	2005	1000	2.35	2191	1043.3	2.50	2330	1083.6	2.69	2509	1121	3.03	2824
3900	869	1.88	1748	918	2.08	1937	963	2.26	2106	1009.4	2.45	2286	1051.3	2.60	2424	1090.3	2.79	2602	1124	3.13	2922
4000	882	1.98	1846	930	2.18	2032	974	2.37	2211	1018.8	2.56	2383	1059.3	2.71	2522	1096.9	2.89	2698	1127	3.24	3021
4100	894	2.09	1950	942	2.29	2131	984	2.49	2321	1028.2	2.66	2484	1067.3	2.81	2623	1103.6	3.00	2796	1131	3.35	3122
4200	907	2.21	2059	955	2.40	2233	994	2.61	2436	1037.5	2.78	2587	1075.3	2.93	2728	1110.3	3.11	2897	1135	3.46	3222
4300	920	2.33	2174	967	2.51	2338	1004	2.74	2556	1046.9	2.89	2694	1083.3	3.04	2836	1117	3.22	3001	1139	3.57	3322

High Horsepower Option Required

**TABLE 24: BLOWER PERFORMANCE 10 TON SIDE DUCT**

CFM	External Static Pressure																				
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8				
	RPM	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	
3000	741	1.20	1122	816	1.35	1256	885	1.46	1365	923	1.69	1571	971	1.91	1784	1035	2.04	1906	1092.2	2.26	2110
3100	755	1.25	1167	828	1.41	1314	876	1.54	1431	933	1.75	1628	980	1.99	1851	1041	2.12	1976	1097.2	2.35	2190
3200	769	1.31	1218	840	1.48	1376	887	1.61	1501	943	1.81	1691	988	2.06	1922	1048	2.20	2049	1102.2	2.44	2274
3300	783	1.37	1274	851	1.55	1443	899	1.69	1575	952	1.89	1760	997	2.14	1997	1054	2.28	2125	1107.2	2.53	2360
3400	797	1.43	1336	863	1.62	1514	910	1.77	1653	962	1.97	1834	1006	2.23	2076	1061	2.37	2205	1112.2	2.63	2448
3500	811	1.51	1404	874	1.70	1589	922	1.86	1735	972	2.05	1915	1015	2.31	2158	1067	2.45	2287	1117.2	2.72	2540
3600	825	1.59	1477	886	1.79	1669	933	1.95	1821	982	2.15	2001	1023	2.41	2244	1073	2.55	2373	1122.2	2.83	2634
3700	839	1.67	1556	897	1.88	1753	944	2.05	1911	992	2.24	2092	1032	2.50	2334	1080	2.64	2462	1127.2	2.93	2732
3800	853	1.76	1641	909	1.98	1841	956	2.15	2005	1002	2.35	2190	1041	2.60	2427	1086	2.74	2554	1132.2	3.04	2832
3900	867	1.86	1731	920	2.07	1934	967	2.26	2103	1012	2.46	2293	1050	2.71	2524	1093	2.84	2649	1137.2	3.15	2934
4000	881	1.96	1827	932	2.18	2031	979	2.37	2205	1022	2.58	2402	1058	2.82	2625	1099	2.95	2747	1142.2	3.26	3040
4100	895	2.07	1928	943	2.29	2132	990	2.48	2311	1032	2.70	2516	1067	2.93	2729	1106	3.06	2848	1147.2	3.38	3148
4200	909	2.18	2035	955	2.40	2238	1001	2.60	2422	1042	2.83	2637	1076	3.04	2838	1112	3.17	2953	-----	-----	-----
4300	923	2.30	2148	966	2.52	2348	1013	2.72	2536	1052	2.96	2763	1084	3.16	2949	1118	3.28	3061	-----	-----	-----
4400	937	2.43	2266	978	2.64	2463	1024	2.85	2654	1062	3.11	2895	1093	3.29	3065	1125	3.40	3171	-----	-----	-----
4500	951	2.56	2390	989	2.77	2581	1036	2.98	2776	1072	3.25	3032	1102	3.42	3184	-----	-----	-----	-----	-----	-----
4600	965	2.70	2519	1001	2.90	2705	1047	3.11	2902	1082	3.41	3175	-----	-----	-----	-----	-----	-----	-----	-----	-----
4700	979	2.85	2654	1012	3.04	2832	1058	3.25	3032	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----
4800	993	3.00	2795	1024	3.18	2964	1070	3.40	3166	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----
4900	1007	3.15	2941	1036	3.33	3100	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----
5000	1021	3.32	3093	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

High Horsepower Option Required

**TABLE 25: BLOWER PERFORMANCE 12-1/2 TON SIDE DUCT**

CFM	External Static Pressure																													
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0											
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts									
3700	840	1.82	1699	888	2.01	1871	941	2.14	1993	997	2.36	2202	1048	2.50	2334	1099	2.67	2485	1146	2.77	2586	1186	2.93	2728						
3800	855	1.92	1786	903	2.09	1947	954	2.24	2085	1009	2.46	2295	1060	2.60	2427	1109	2.76	2576	1155	2.88	2680	1195	3.04	2834						
3900	870	2.01	1877	917	2.18	2028	968	2.34	2182	1022	2.57	2392	1071	2.71	2524	1120	2.87	2672	1163	2.98	2780	1204	3.16	2947						
4000	885	2.12	1973	932	2.27	2115	982	2.45	2283	1035	2.68	2494	1083	2.82	2626	1130	2.98	2774	1171	3.10	2887	1212	3.29	3066						
4100	834	2.11	1970	900	2.22	2072	946	2.37	2207	996	2.56	2390	1048	2.79	2601	1109	2.93	2733	1140	3.09	2881	1179	3.22	3000	1221	3.42	3192			
4200	851	2.19	2042	915	2.33	2175	961	2.47	2305	1009	2.68	2501	1061	2.91	2712	1106	3.05	2844	1150	3.21	2993	1188	3.35	3119	1230	3.57	3324			
4300	868	2.28	2121	931	2.45	2283	975	2.58	2409	1023	2.81	2616	1074	3.03	2828	1117	3.18	2960	1160	3.34	3111	1196	3.48	3245	1239	3.71	3462			
4400	885	2.37	2208	946	2.57	2395	990	2.70	2518	1037	2.94	2736	1087	3.16	2948	1129	3.30	3080	1171	3.47	3234	1204	3.62	3377	1247	3.87	3607			
4500	838	2.23	2083	901	2.47	2301	961	2.69	2511	1004	2.82	2633	1051	3.07	2862	1099	3.30	3072	1141	3.44	3204	1181	3.61	3362	1212	3.77	3515	1256	4.03	3758
4600	854	2.34	2184	918	2.58	2401	976	2.82	2631	1019	2.95	2753	1064	3.21	2991	1112	3.43	3201	1152	3.58	3333	1191	3.75	3496	1221	3.93	3659	1265	4.20	3916
4700	870	2.46	2291	935	2.69	2508	991	2.96	2755	1033	3.09	2879	1078	3.35	3126	1125	3.58	3335	1164	3.72	3467	1201	3.90	3635	1229	4.09	3810	1273	4.38	4080
4800	887	2.58	2406	952	2.81	2622	1007	3.09	2883	1048	3.23	3011	1092	3.50	3265	1138	3.73	3473	1175	3.87	3605	1211	4.05	3779	1237	4.26	3967	1282	4.56	4250
4900	903	2.71	2527	968	2.94	2744	1022	3.24	3016	1062	3.38	3148	1105	3.66	3409	1151	3.88	3616	1187	4.02	3748	1222	4.21	3929	1245	4.43	4131	1291	4.75	4427
5000	919	2.85	2656	985	3.08	2872	1037	3.38	3152	1077	3.53	3291	1119	3.82	3558	1164	4.04	3763	1198	4.18	3895	1232	4.38	4083	1254	4.61	4301	1300	4.95	4610
5100	936	2.99	2791	1002	3.23	3007	1052	3.53	3293	1091	3.69	3439	1133	3.98	3711	1177	4.20	3914	1210	4.34	4046	1242	4.55	4244	1262	4.80	4477	1308	5.15	4800
5200	952	3.15	2934	1018	3.38	3149	1067	3.69	3438	1106	3.85	3593	1147	4.15	3869	1189	4.37	4070	1221	4.51	4202	1252	4.73	4409	1270	5.00	4660	1317	5.36	4996
5300	968	3.31	3083	1035	3.54	3298	1083	3.85	3587	1120	4.03	3753	1160	4.33	4032	1202	4.54	4231	1233	4.68	4363	1262	4.91	4580	1278	5.20	4848	1317	5.56	5000
5400	984	3.48	3240	1052	3.71	3455	1098	4.01	3740	1135	4.20	3918	1174	4.51	4200	1215	4.72	4396	1244	4.86	4528	1273	5.10	4757	1286	5.41	5044	1317	5.76	5300
5500	1001	3.65	3403	1069	3.88	3618	1113	4.18	3897	1149	4.39	4089	1188	4.69	4372	1228	4.90	4566	1256	5.04	4698	1283	5.30	4938	1293	5.50	5125	1317	5.86	5600
5600	1017	3.83	3574	1085	4.06	3788	1128	4.35	4058	1164	4.58	4265	1201	4.88	4549	1241	5.08	4740	1267	5.23	4872	1293	5.50	5125	1317	5.86	5600	1317	6.22	6000
5700	1033	4.02	3751	1102	4.25	3965	1143	4.53	4224	1178	4.77	4447	1215	5.07	4731	1254	5.28	4918	1279	5.42	5050	1293	5.70	5212	1317	6.02	6000	1317	6.38	6400
5800	1050	4.22	3936	1119	4.45	4149	1159	4.71	4393	1193	4.97	4635	1229	5.27	4917	1267	5.47	5101	1293	5.61	5231	1317	5.89	5392	1317	6.18	6000	1317	6.54	6800
5900	1066	4.43	4127	1136	4.66	4341	1174	4.90	4567	1207	5.18	4828	1243	5.48	5108	1293	5.70	5282	1317	5.84	5462	1317	6.11	5623	1317	6.48	6000	1317	6.84	7200
6000	1082	4.64	4326	1152	4.87	4539	1189	5.09	4745	1222	5.39	5027	1267	5.69	5307	1317	5.91	5498	1317	6.05	5678	1317	6.32	5899	1317	6.68	6000	1317	7.00	7600
6100	1098	4.86	4531	1169	5.09	4744	1204	5.29	4927	1236	5.61	5231	1293	5.93	5542	1317	6.15	5743	1317	6.21	5924	1317	6.48	6185	1317	6.84	6000	1317	7.20	7600
6200	1098	4.86	4531	1169	5.09	4744	1204	5.29	4927	1236	5.61	5231	1293	5.93	5542	1317	6.15	5743	1317	6.21	5924	1317	6.48	6185	1317	6.84	6000	1317	7.20	7600

High Horsepower Option Required

**TABLE 26: BLOWER PERFORMANCE 6-1/2 TON DOWNSHOT**

CFM	External Static Pressure																				
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6						
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts			
1900	----	----	698	733	0.75	804	0.9	825	881	1.03	963	931	1.21	1124	980	1.37	1279	1019	1.51	1409	
2000	----	----	742	745	0.8	814	0.94	872	885	1.09	1017	939	1.27	1181	987	1.43	1336	1025	1.57	1465	
2100	----	----	789	756	0.85	824	0.99	922	889	1.15	1073	946	1.33	1240	993	1.5	1395	1031	1.63	1521	
2200	----	----	839	767	0.9	839	1.05	975	894	1.21	1131	954	1.4	1301	1000	1.56	1454	1036	1.69	1578	
2300	----	----	891	778	0.96	891	1.1	1030	898	1.28	1191	962	1.46	1363	1006	1.63	1515	1042	1.76	1636	
2400	----	----	946	789	1.01	946	1.17	1088	902	1.34	1253	969	1.53	1426	1013	1.69	1577	1047	1.82	1695	
2500	----	----	1003	801	1.08	1003	1.23	1148	906	1.41	1317	977	1.6	1491	1019	1.76	1641	1053	1.88	1755	
2600	----	----	1063	812	1.14	1063	1.3	1211	910	1.48	1384	985	1.67	1558	1026	1.83	1705	1059	1.95	1816	
2700	728	0.76	709	767	1.03	964	823	1.21	1125	886	1.37	1276	914	1.56	1452	992	1.75	1627	1032	1.9	1771
2800	739	0.86	801	778	1.11	1035	834	1.28	1190	896	1.44	1344	918	1.63	1523	1000	1.82	1697	1039	1.97	1838
2900	750	0.96	894	790	1.19	1107	846	1.35	1257	906	1.52	1414	923	1.71	1596	1008	1.9	1769	1045	2.04	1906
3000	761	1.06	987	801	1.27	1182	857	1.42	1327	916	1.59	1487	927	1.79	1671	1015	1.98	1842	-----	-----	-----
3100	772	1.16	1080	813	1.35	1258	868	1.5	1400	926	1.68	1562	931	1.87	1748	1023	2.06	1917	-----	-----	-----
3200	784	1.26	1175	825	1.43	1336	879	1.58	1475	937	1.76	1640	935	1.96	1827	-----	-----	-----	-----	-----	-----
3300	795	1.36	1269	836	1.52	1417	890	1.67	1552	947	1.85	1721	939	2.05	1908	-----	-----	-----	-----	-----	-----

High Horsepower Option Required

Motor Efficiency 0.8

Std HP Motor 1.5

**TABLE 27: BLOWER PERFORMANCE 7-1/2 TON DOWNSHOT**

CFM	External Static Pressure															
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6	
	RPM	Watts	RPM	Watts	RPM	Watts	RPM	Watts	RPM	Watts	RPM	Watts	RPM	Watts	RPM	Watts
2200	791	726	830	1015	889	123	1149	950	136	1272	1004	154	1435	1046	171	1597
2300	798	811	839	1077	897	129	1203	958	143	1330	1011	161	1497	1052	178	1660
2400	806	894	848	1138	906	135	1258	966	149	1389	1018	167	1561	1058	185	1725
2500	814	977	857	1200	915	141	1314	974	156	1450	1025	174	1626	1064	192	1790
2600	822	1058	865	1261	924	147	1371	982	162	1512	1032	182	1692	1070	199	1857
2700	830	1139	874	1323	933	153	1429	990	169	1576	1039	189	1760	1076	207	1925
2800	838	1218	883	1384	941	160	1488	998	176	1640	1046	196	1829	1082	214	1991
2900	846	1296	892	1446	950	166	1548	1007	183	1707	1053	204	1899	1088	221	2057
3000	854	1373	900	1508	959	173	1609	1015	190	1774	1060	211	1971	1094	228	2123
3100	862	1449	909	1569	968	179	1671	1023	198	1843	1066	218	2043	1100	235	2189
3200	869	1524	918	1631	976	186	1734	1031	205	1914	1072	225	2115	1106	242	2255
3300	877	1598	927	1692	985	193	1798	1039	213	1986	1078	232	2187	1112	249	2321
3400	885	1671	936	1754	994	200	1863	1047	221	2059	1084	239	2259	1118	256	2387
3500	893	1742	944	1816	1003	207	1928	1054	229	2132	1090	246	2331	1124	263	2453
3600	901	1813	953	1877	1012	214	1995	1061	237	2205	1096	253	2403	1130	270	2519
3700	909	1883	962	1939	1020	221	2063	1067	245	2278	1102	260	2475	1136	277	2585
3800	917	1951	971	2001	1029	229	2132	1073	253	2351	1108	267	2547	1142	284	2651

High Horsepower Option Required

Motor Efficiency 0.8

Std HP Motor 1.5

**TABLE 28: BLOWER PERFORMANCE 8-1/2 TON DOWNSHOT**

CFM	External Static Pressure																							
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0					
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts			
2300	713	1.03	959	795	1.09	1012	863	1.19	1108	920	1.32	1233	967	1.47	1374	1004	1.62	1508	1034	1.73	1615	1056	1.81	1686
2400	727	1.06	984	807	1.13	1054	874	1.25	1163	929	1.39	1296	974	1.55	1441	1010	1.69	1577	1039	1.81	1683	1061	1.88	1751
2500	742	1.09	1014	819	1.18	1101	884	1.31	1221	938	1.46	1362	981	1.62	1511	1016	1.77	1647	1044	1.88	1752	1065	1.95	1817
2600	756	1.13	1049	831	1.24	1152	894	1.38	1282	946	1.53	1430	989	1.70	1583	1023	1.84	1720	1049	1.95	1822	1070	2.02	1885
2700	771	1.17	1091	843	1.29	1207	904	1.45	1347	955	1.61	1501	996	1.78	1657	1029	1.92	1794	1054	2.03	1894	1074	2.10	1953
2800	785	1.22	1138	856	1.36	1267	915	1.52	1416	964	1.69	1576	1003	1.86	1733	1035	2.01	1870	1060	2.11	1967	1079	2.17	2023
2900	800	1.28	1190	868	1.43	1331	925	1.60	1488	972	1.77	1653	1011	1.94	1812	1041	2.09	1947	1065	2.19	2041	1083	2.25	2093
3000	814	1.34	1248	880	1.50	1400	935	1.68	1564	981	1.86	1732	1018	2.03	1893	1047	2.17	2026	1070	2.27	2117	1087	2.32	2165
3100	829	1.41	1312	892	1.58	1473	945	1.76	1643	990	1.95	1815	1025	2.12	1976	1053	2.26	2107	1075	2.35	2194	1092	2.40	2237
3200	843	1.48	1381	904	1.66	1550	956	1.85	1726	998	2.04	1900	1032	2.21	2061	1060	2.35	2190	1080	2.44	2273	1100	2.50	2280
3300	858	1.56	1456	916	1.75	1632	966	1.94	1812	1007	2.13	1989	1040	2.31	2149	1066	2.44	2275	1086	2.52	2352	1100	2.50	2280
3400	872	1.65	1537	929	1.84	1719	976	2.04	1902	1015	2.23	2080	1047	2.40	2239	1072	2.53	2361	1100	2.50	2280	1100	2.50	2280
3500	887	1.74	1623	941	1.94	1810	986	2.14	1995	1024	2.33	2174	1054	2.50	2331	1078	2.63	2449	1100	2.50	2280	1100	2.50	2280
3600	901	1.84	1715	953	2.04	1905	997	2.24	2092	1033	2.44	2270	1062	2.60	2425	1084	2.72	2538	1100	2.50	2280	1100	2.50	2280
3700	916	1.94	1812	965	2.15	2005	1007	2.35	2193	1041	2.54	2370	1069	2.71	2522	1090	2.82	2630	1100	2.50	2280	1100	2.50	2280
3800	930	2.05	1915	977	2.26	2109	1017	2.46	2297	1050	2.65	2473	1076	2.81	2621	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280
3900	945	2.17	2023	990	2.38	2218	1027	2.58	2405	1059	2.77	2578	1083	2.92	2722	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280
4000	959	2.29	2138	1002	2.50	2331	1038	2.70	2516	1067	2.88	2686	1091	3.03	2825	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280
4100	974	2.42	2257	1014	2.63	2449	1048	2.82	2631	1076	3.00	2797	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280
4200	988	2.56	2383	1026	2.76	2571	1058	2.95	2749	1085	3.12	2911	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280	1100	2.50	2280

High Horsepower Option Required

Motor Efficiency 0.8

Std HP Motor 2



**TABLE 29: BLOWER PERFORMANCE 10 TON DOWNSHOT**

CFM	External Static Pressure																							
	0.2			0.4			0.6			0.8			1.0			1.2			1.4			1.6		
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts
3000	741	1.21	1128	814	1.34	1248	880	1.50	1400	935	1.68	1564	981	1.86	1732	1018	2.03	1893	1047	2.17	2026	1072	2.35	2190
3100	758	1.26	1178	829	1.41	1312	892	1.58	1473	945	1.76	1643	990	1.95	1815	1025	2.12	1976	1053	2.26	2107	1080	2.41	2275
3200	775	1.32	1234	843	1.48	1381	904	1.66	1550	956	1.85	1726	998	2.04	1900	1032	2.21	2061	1060	2.35	2190	1087	2.50	2361
3300	792	1.39	1298	858	1.56	1456	916	1.75	1632	966	1.94	1812	1007	2.13	1989	1040	2.31	2149	1066	2.44	2275	1093	2.59	2446
3400	809	1.47	1369	872	1.65	1537	929	1.84	1719	976	2.04	1902	1015	2.23	2080	1047	2.40	2239	1072	2.53	2361	1100	2.68	2537
3500	826	1.55	1447	887	1.74	1623	941	1.94	1810	986	2.14	1995	1024	2.33	2174	1054	2.50	2331	1099	2.63	2498	1127	2.78	2674
3600	843	1.64	1532	901	1.84	1715	953	2.04	1905	997	2.24	2092	1033	2.44	2270	1062	2.60	2425	1114	2.72	2611	1144	2.87	2844
3700	860	1.74	1624	916	1.94	1812	965	2.15	2005	1007	2.35	2193	1041	2.54	2370	1069	2.71	2522	1131	2.86	2748	1171	3.01	2981
3800	877	1.85	1723	930	2.05	1915	977	2.26	2109	1017	2.46	2297	1050	2.65	2473	1076	2.81	2621	1148	2.90	2844	1208	3.16	3224
3900	894	1.96	1829	945	2.17	2023	990	2.38	2218	1027	2.58	2405	1059	2.77	2578	1093	2.95	2748	1175	3.04	2981	1248	3.31	3461
4000	911	2.08	1943	959	2.29	2138	1002	2.50	2331	1038	2.70	2516	1067	2.88	2686	1110	3.12	2948	1212	3.20	3174	1288	3.46	3701
4100	928	2.21	2063	974	2.42	2257	1014	2.63	2449	1048	2.82	2631	1076	3.00	2797	1127	3.20	3174	1229	3.29	3231	1328	3.61	4001
4200	945	2.35	2190	988	2.56	2383	1026	2.76	2571	1058	2.95	2749	1093	3.14	3001	1144	3.29	3231	1246	3.38	3331	1368	3.86	4441
4300	962	2.49	2324	1003	2.70	2514	1038	2.89	2697	1068	3.08	2871	1100	3.27	3174	1161	3.37	3331	1263	3.47	3431	1408	4.11	4881
4400	979	2.65	2466	1017	2.84	2650	1050	3.03	2828	1079	3.21	2996	1117	3.46	3331	1178	3.46	3331	1280	3.56	3531	1448	4.36	5321
4500	996	2.80	2614	1032	3.00	2792	1063	3.18	2963	1093	3.30	3174	1135	3.65	3631	1195	3.64	3631	1307	3.74	3631	1488	4.61	5861
4600	1013	2.97	2770	1046	3.15	2940	1075	3.33	3103	1110	3.49	3231	1152	3.84	3831	1212	3.82	3831	1324	3.91	3831	1528	4.86	6401
4700	1030	3.15	2932	1061	3.32	3094	1093	3.56	3231	1127	3.64	3331	1169	4.04	4031	1229	4.02	4031	1341	4.11	4031	1568	5.11	6941
4800	1047	3.33	3102	1075	3.49	3253	1110	3.81	3431	1144	4.03	3531	1186	4.24	4231	1246	4.22	4231	1358	4.31	4231	1608	5.36	7481
4900	1065	3.52	3278	1088	3.68	3456	1127	4.00	3631	1161	4.22	3731	1203	4.44	4431	1263	4.42	4431	1375	4.51	4431	1648	5.61	8021
5000	1082	3.71	3462	1103	3.87	3681	1144	4.17	3831	1186	4.41	3931	1220	4.64	4631	1280	4.62	4631	1392	4.71	4631	1688	5.86	8561

High Horsepower Option Required

Motor Efficiency 0.8

Std HP Motor 2

**TABLE 30: BLOWER PERFORMANCE 12-1/2 TON DOWNSHOT**

CFM	External Static Pressure																														
	0.2		0.4		0.6		0.8		1.0		1.2		1.4		1.6		1.8		2.0												
	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts	RPM	BHP	Watts										
3700	----	----	----	----	----	----	908	1.99	1853	957	2.12	1976	1004	2.27	2112	1050	2.42	2258	1094	2.59	2412	1136	2.76	2571	1177	2.93	2733	1217	3.11	2895	
3800	----	----	----	875	1.96	1831	926	2.09	1946	974	2.23	2077	1020	2.38	2220	1065	2.54	2372	1108	2.71	2530	1151	2.89	2693	1191	3.06	2856	1231	3.24	3021	
3900	----	----	----	893	2.06	1918	943	2.19	2044	990	2.34	2183	1036	2.50	2332	1080	2.67	2489	1123	2.84	2652	1165	3.02	2817	1205	3.20	2983	1244	3.38	3149	
4000	----	----	----	911	2.16	2012	960	2.30	2147	1007	2.46	2294	1052	2.63	2449	1096	2.80	2611	1138	2.98	2777	1179	3.16	2945	1219	3.34	3113	1258	3.52	3280	
4100	878	2.13	1984	929	2.27	2113	977	2.42	2256	1023	2.59	2410	1068	2.76	2571	1111	2.94	2737	1153	3.12	2906	1194	3.30	3076	1233	3.48	3245	1271	3.66	3414	
4200	897	2.23	2080	947	2.38	2219	995	2.54	2371	1040	2.72	2531	1084	2.89	2697	1127	3.08	2867	1168	3.26	3039	1208	3.44	3211	1247	3.63	3381	1285	3.81	3550	
4300	915	2.34	2184	965	2.50	2332	1012	2.67	2491	1056	2.85	2657	1100	3.03	2828	1142	3.22	3001	1183	3.41	3175	1223	3.59	3348	1261	3.78	3520	1298	3.96	3690	
4400	934	2.46	2294	983	2.63	2451	1029	2.81	2617	1073	2.99	2788	1116	3.18	2963	1157	3.37	3139	1198	3.56	3315	1237	3.74	3490	1275	3.93	3662	1311	4.11	3832	
4500	953	2.59	2411	1001	2.76	2577	1046	2.95	2749	1090	3.14	2925	1132	3.33	3103	1173	3.52	3281	1212	3.71	3459	1251	3.90	3634	1289	4.08	3807	1325	4.27	3977	
4600	972	2.72	2536	1019	2.91	2708	1063	3.10	2886	1106	3.29	3066	1148	3.48	3247	1188	3.68	3428	1227	3.87	3606	1266	4.06	3782	1303	4.24	3955	1338	4.43	4125	
4700	991	2.86	2667	1036	3.05	2846	1081	3.25	3029	1123	3.45	3212	1164	3.64	3396	1204	3.84	3578	1242	4.03	3758	1280	4.22	3933	1316	4.40	4106	1352	4.59	4275	
4800	1009	3.01	2806	1054	3.21	2990	1098	3.41	3177	1139	3.61	3364	1180	3.81	3549	1219	4.00	3732	1257	4.20	3912	1294	4.39	4088	1330	4.57	4260	1365	4.75	4429	
4900	1028	3.17	2951	1072	3.37	3141	1115	3.57	3331	1156	3.78	3520	1196	3.98	3707	1234	4.17	3891	1272	4.37	4071	1309	4.56	4246	1344	4.74	4417	1379	4.92	4585	
5000	1047	3.33	3103	1090	3.54	3297	1132	3.74	3491	1172	3.95	3682	1211	4.15	3870	1250	4.35	4054	1287	4.54	4233	1323	4.73	4407	1358	4.91	4577	1392	5.09	4744	
5100	1066	3.50	3263	1108	3.71	3460	1149	3.92	3656	1189	4.13	3848	1227	4.33	4037	1265	4.53	4221	1302	4.72	4399	1338	4.91	4572	1372	5.09	4740	----	----	----	
5200	1084	3.68	3430	1126	3.89	3629	1167	4.11	3827	1205	4.31	4020	1243	4.51	4208	1281	4.71	4391	1317	4.90	4569	1352	5.09	4740	----	----	----	----	----		
5300	1103	3.87	3603	1144	4.08	3805	1184	4.29	4003	1222	4.50	4196	1259	4.70	4384	1296	4.90	4566	1331	5.09	4742	----	----	----	----	----	----	----	----	----	
5400	1122	4.06	3784	1162	4.28	3987	1201	4.49	4185	1238	4.70	4378	1275	4.90	4565	1311	5.09	4745	----	----	----	----	----	----	----	----	----	----	----	----	
5500	1141	4.26	3971	1180	4.48	4175	1218	4.69	4373	1255	4.90	4564	1291	5.10	4750	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	
5600	1160	4.47	4166	1198	4.69	4369	1235	4.90	4566	1271	5.10	4756	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	
5700	1178	4.69	4368	1216	4.90	4569	1253	5.11	4765	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	
5800	1197	4.91	4576	1234	5.12	4776	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	
5900	1216	5.14	4792	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	
6000	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----
6100	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----
6200	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

High Horsepower Option Required

Motor Efficiency 0.8

Std HP Motor 3

**TABLE 31: ADDITIONAL STATIC RESISTANCE**

CFM	Cooling Only*	Economizer† ‡	Electric Heat KW†				
			9	18	24	36	54
1900	0.06	0.02	0.05	0.06	0.07	0.08	0.10
2100	0.07	0.02	0.06	0.07	0.08	0.09	0.11
2300	0.08	0.02	0.07	0.08	0.09	0.10	0.13
2500	0.09	0.02	0.08	0.09	0.10	0.11	0.14
2700	0.11	0.03	0.09	0.10	0.12	0.13	0.16
2900	0.12	0.03	0.10	0.11	0.13	0.14	0.18
3100	0.14	0.03	0.12	0.13	0.15	0.16	0.20
3300	0.16	0.03	0.13	0.14	0.17	0.18	0.22
3500	0.18	0.04	0.15	0.16	0.19	0.20	0.24
3700	0.20	0.04	0.17	0.18	0.21	0.22	0.26
3900	0.23	0.04	0.19	0.20	0.23	0.24	0.28
4100	0.25	0.04	0.21	0.22	0.25	0.26	0.31
4300	0.28	0.05	0.23	0.24	0.28	0.29	0.34
4500	0.30	0.05	0.25	0.26	0.30	0.31	0.37
4700	0.33	0.05	0.28	0.29	0.33	0.34	0.40
4900	0.36	0.05	0.30	0.31	0.35	0.37	0.43
5100	0.39	0.06	0.33	0.34	0.38	0.40	0.46
5300	0.42	0.06	0.35	0.37	0.41	0.43	0.49
5500	0.45	0.06	0.38	0.40	0.44	0.46	0.53
5700	0.48	0.06	0.41	0.43	0.47	0.49	0.56
5900	0.52	0.07	0.44	0.46	0.50	0.53	0.59
6100	0.56	0.07	0.47	0.49	0.53	0.56	0.62
6300	0.60	0.07	0.50	0.53	0.56	0.59	0.65

\* Add these resistance values to the available static resistance in the respective Blower Performance Tables.

† Deduct these resistance values from the available external static pressure shown in the respective Blower Performance Table.

‡ The pressure drop through the economizer is greater for 100% outdoor air than for 100% return air. If the resistance of the return air duct system is less than 0.25 IWG, the unit will deliver less CFM during full economizer operation.

**TABLE 32: ELECTRIC HEAT MINIMUM SUPPLY AIR CFM**

HEATER		UNIT MODEL SIZE, NOMINAL TONS				
kW	VOLTAGE	6.5	7.5	8.5	10	12.5
		MINIMUM SUPPLY AIR CFM				
9	208/230	1950	2250	2550	N/A	N/A
18		1950	2250	2550	3000	3750
24		1950	2250	2550	3000	3750
36		1950	2250	2550	3000	3750
54		N/A	N/A	N/A	3500	4000
9	480	1950	2250	2550	N/A	N/A
18		1950	2250	2550	3000	3750
24		1950	2250	2550	3000	3750
36		1950	2250	2550	3000	3750
54		N/A	N/A	N/A	3000	3750
9	600	1950	2250	2550	N/A	N/A
18		1950	2250	2550	3000	3750
24		1950	2250	2550	3000	3750
36		1950	2250	2550	3000	3750
54		N/A	N/A	N/A	3500	3750


**TABLE 33: INDOOR BLOWER SPECIFICATIONS**

MODEL	MOTOR					MOTOR SHEAVE			BLOWER SHEAVE			BELT
	HP	RPM	Eff.	SF	Frame	Datum Dia. (in.)	Bore (in.)	Model	Datum Dia. (in.)	Bore (in.)	Model	
DM078	1-1/2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	9.5	1	AK99	A58
	2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	7.5	1	AK79	A55
DM090	1-1/2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	9.0	1	AK94	A57
	2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	7.5	1	AK79	A55
DM102	2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	9.0	1	AK94	A56
	3	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	7.0	1	AK74	A54
DM120	2	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	8.5	1	AK89	A56
	3	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	7.0	1	AK74	A54
DM150	3	1725	80%	1.15	56	3.4 - 4.4	7/8	1VM50	7.0	1	AK74	A54
	5	1725	87%	1.15	184T	4.3 - 5.3	1 1/8	1VP56	6.7	1	BK77	BX55


**TABLE 34: POWER EXHAUST SPECIFICATIONS**

POWER EXHAUST MODEL	VOLT	PHASE	MOTOR			ELECTRICAL			FUSE SIZE	CFM@ 0.1 ESP
			HP	RPM*	QTY	LRA	FLA	MCA		
2PE0473125	208/230	1	0.75	1075	1	24.9	5.0	6.3	10	3,800
2PE0473146	460	1		N/A		2.2	2.8	5		
2PE0473158	575	1		1050		1.5	1.9	4		


\* Motors are multi-tapped and factory wired for high speed.

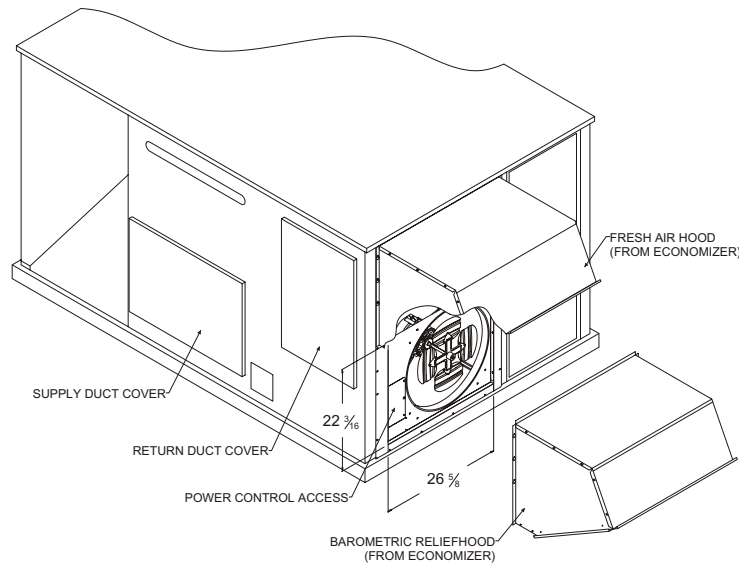

**FIGURE 2 - POWER EXHAUST ACCESSORY DOWNFLOW APPLICATION**

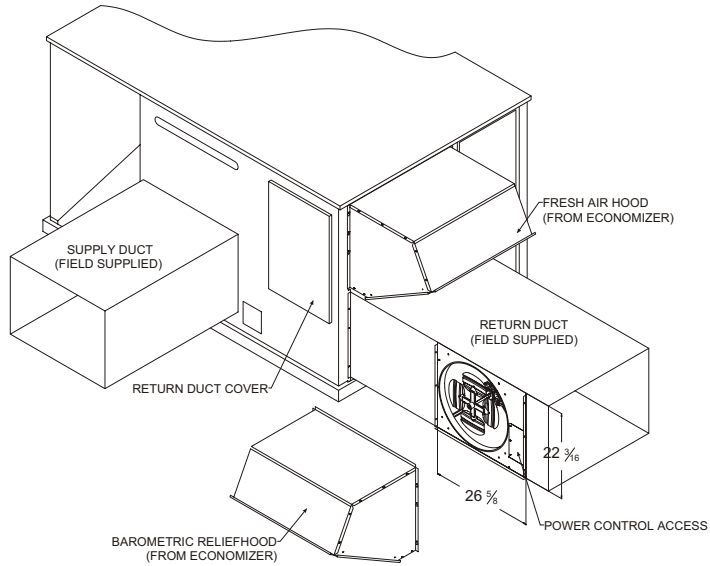


**FIGURE 3 - POWER EXHAUST ACCESSORY HORIZONTAL APPLICATION**

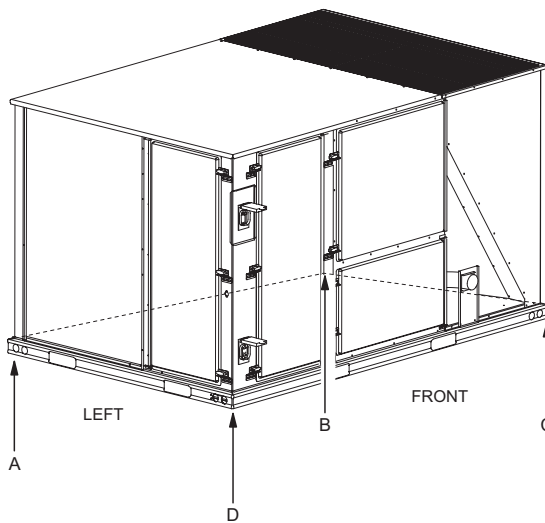


**FIGURE 4 - UNIT 4 POINT LOAD**

**TABLE 35: 4 POINT LOAD WEIGHT**

Model	Location (lbs.)			
	A	B	C	D
DM078	228	195	285	333
DM090	230	197	287	336
DM102	238	203	296	347
DM120	245	209	305	357
DM150	262	224	327	382

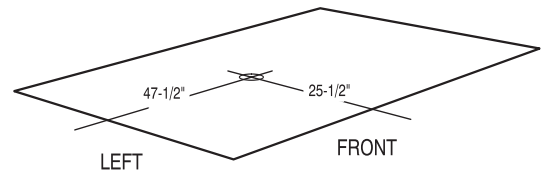

**FIGURE 5 - UNIT CENTER OF GRAVITY**

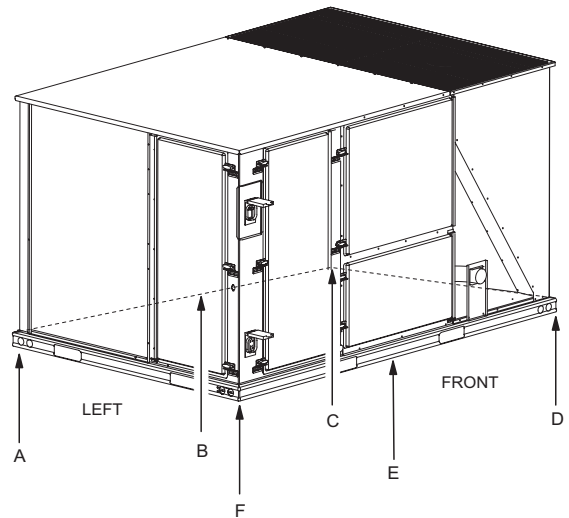


**FIGURE 6 - UNIT 6 POINT LOAD**

**TABLE 36: 6 POINT LOAD WEIGHT**

Model	Locations (lbs.)					
	A	B	C	D	E	F
DM078	156	140	127	185	205	228
DM090	158	142	128	187	207	230
DM102	163	146	132	192	213	237
DM120	168	151	136	198	219	244
DM150	180	161	145	212	235	262


**TABLE 37: UNIT WEIGHT**

Model	Shipping Weight (lbs.)	Operating Weight (lbs.)
DM078	1046	1041
DM090	1056	1051
DM102	1089	1084
DM120	1121	1116
DM150	1200	1195

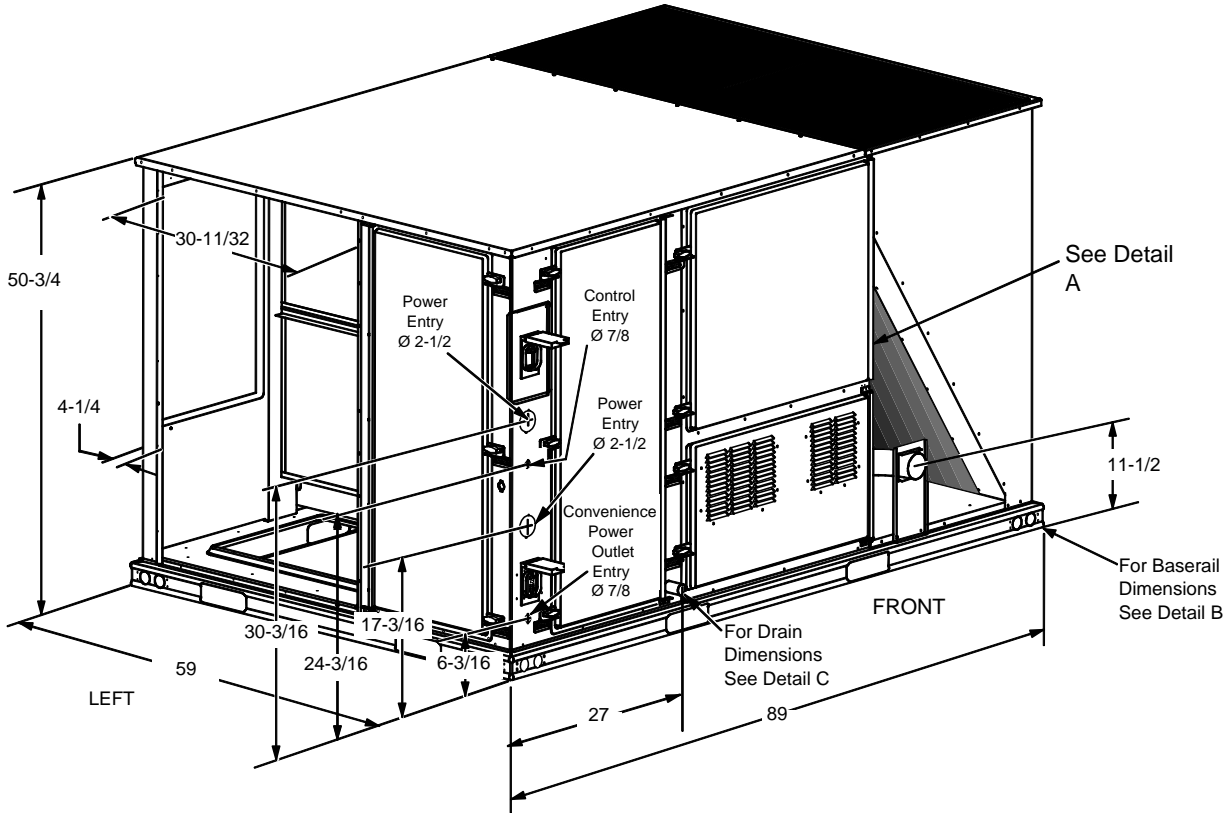

**FIGURE 7 - UNIT DIMENSIONS**

**DETAIL A**

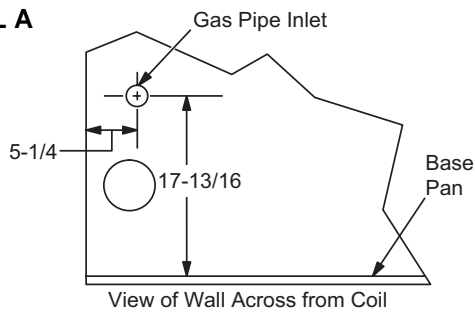

**TABLE 38: UNIT CLEARANCES**


Top*	72"	Right	12"
Front	36"	Left	36"
Rear†	36"	Bottom‡	0"

\* Units must be installed outdoors. Overhanging structure or shrubs should not obstruct condenser air discharge outlet.



† To remove the slide-out drain pan, a rear clearance of 60" is required. If space is unavailable, the drain pan can be removed through the front by separating the corner wall.

‡ Units may be installed on combustible floors made from wood or class A, B or C roof covering materials.

**DETAIL B**

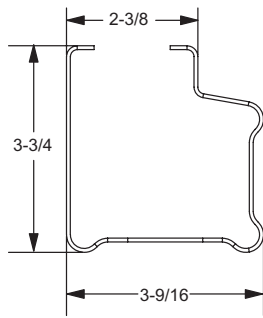

**DETAIL C**

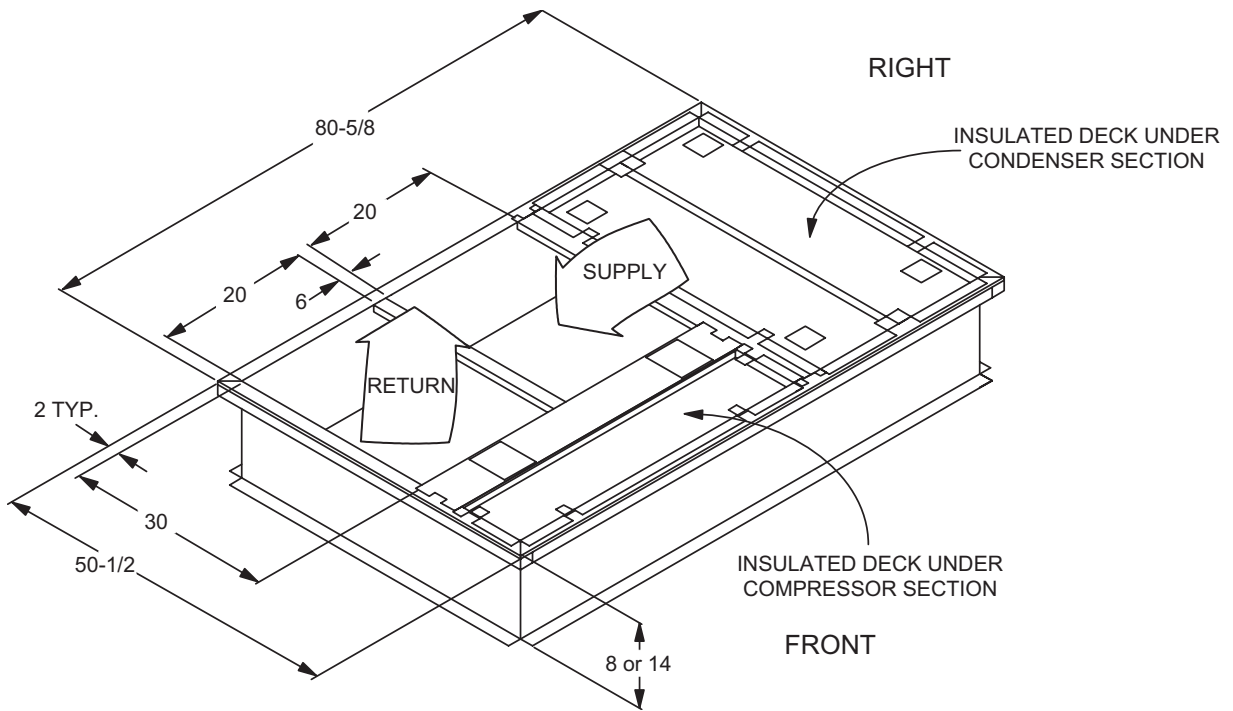

**FIGURE 8 - PREDATOR® ROOF CURB DIMENSIONS**

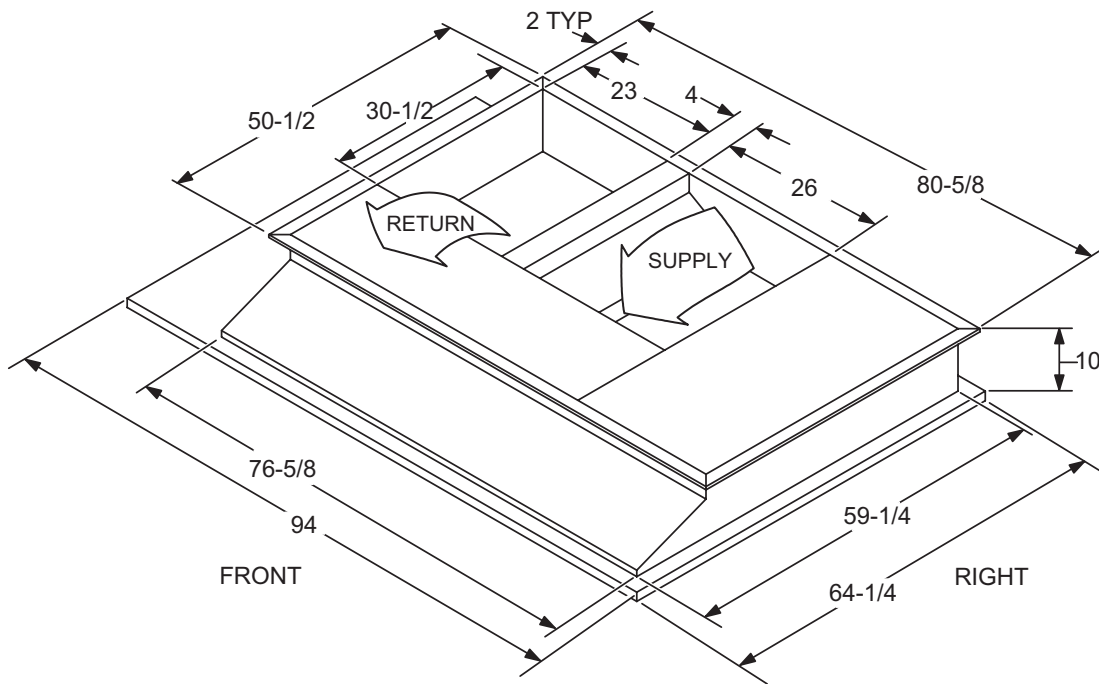


FIGURE 9 - SUNLINE™ TO PREDATOR® TRANSITION ROOF CURBS


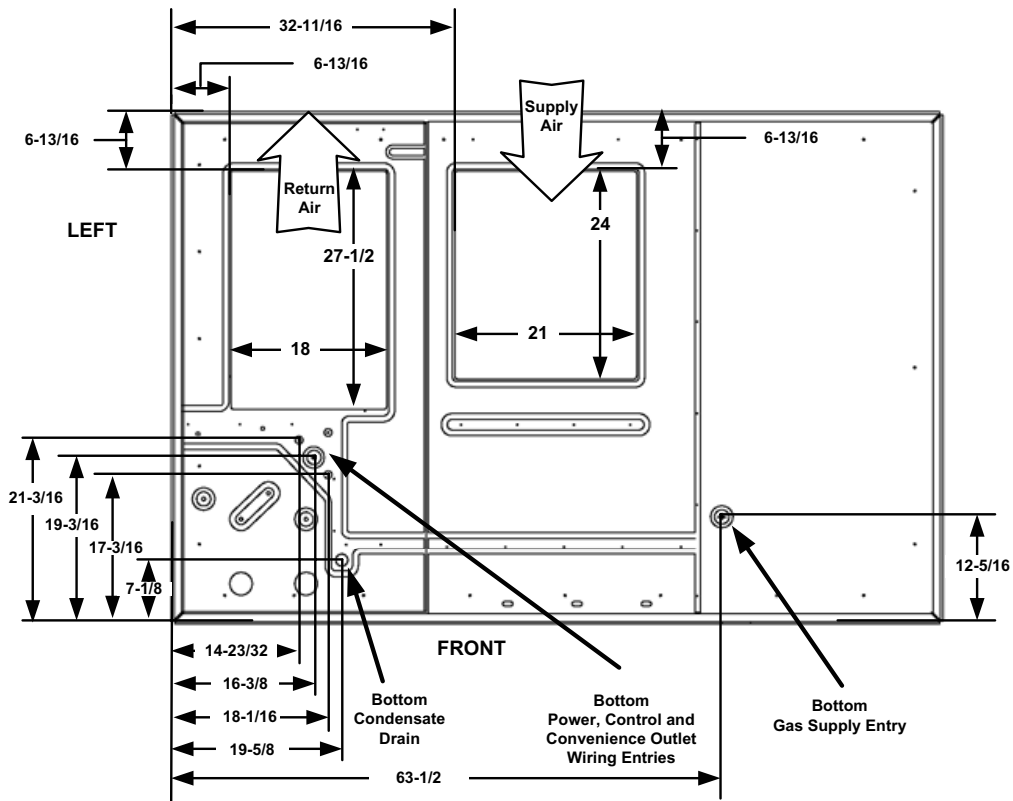


FIGURE 10 - BOTTOM DUCT OPENINGS (FROM ABOVE)



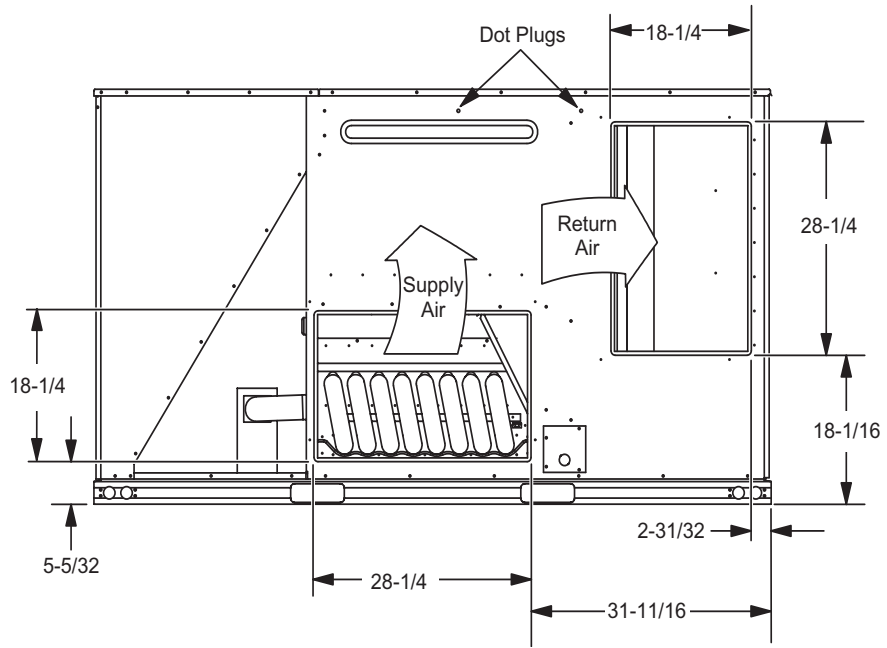

**FIGURE 11 - REAR DUCT DIMENSIONS**



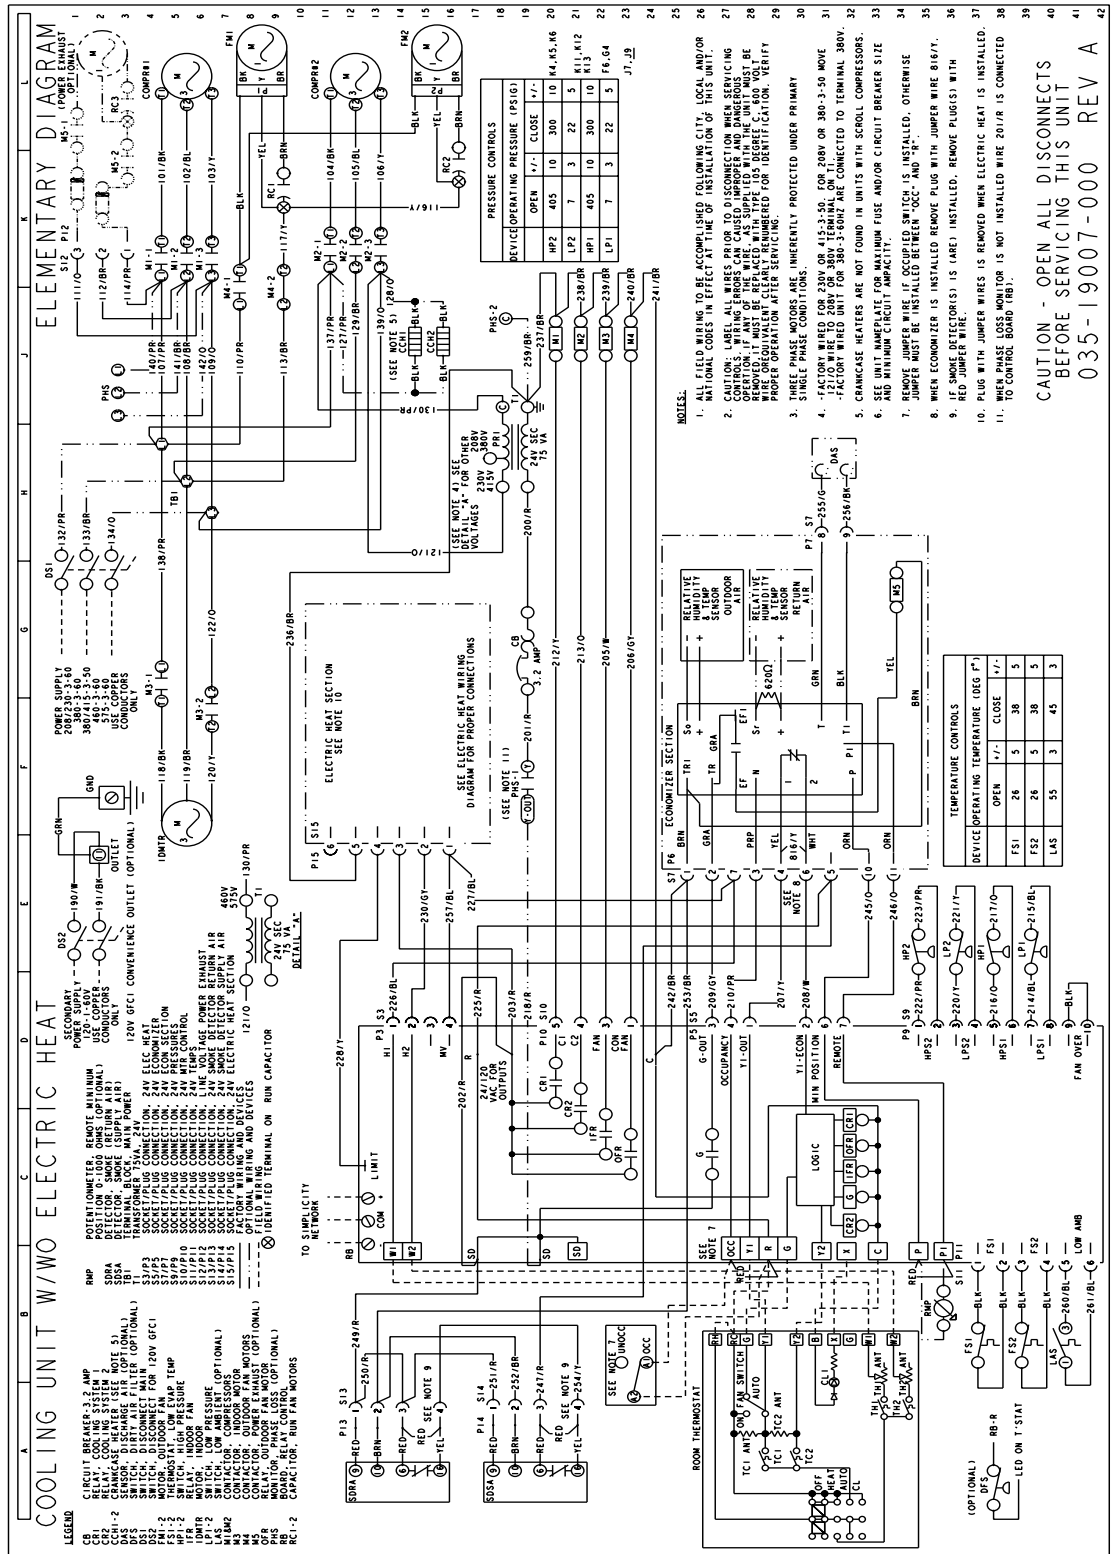


FIGURE 13 - COOLING UNIT WITH/WITHOUT ELECTRIC HEAT WIRING DIAGRAM

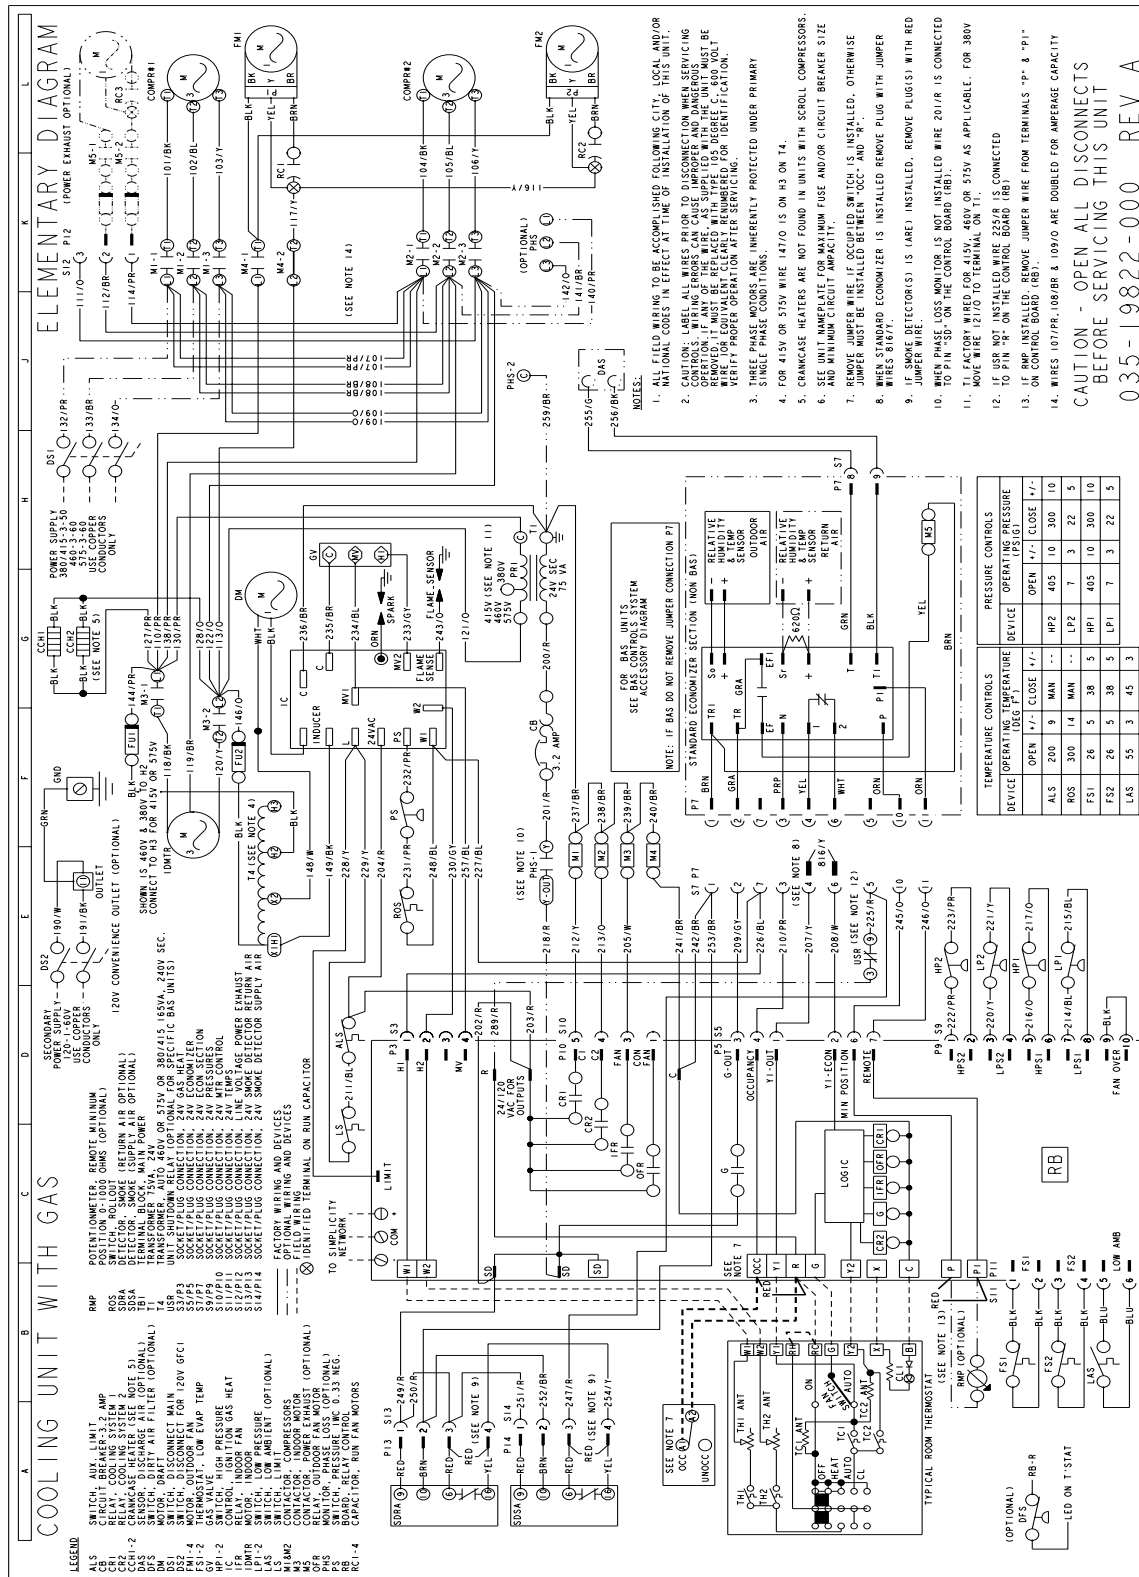


FIGURE 14 - COOLING UNIT WITH GAS HEAT WIRING 460, 575 VOLT AND 50 HZ DIAGRAM

## GUIDE SPECIFICATIONS

### PREDATOR® DM 078, 090, 102, 120 & 150 9.0 EER

#### GENERAL

Units shall be manufactured by York International Unitary Products Group in an ISO 9001 certified facility. YORK® Predator® units are convertible single packages with a common footprint cabinet and common roof curb for all 6-1/2 through 12-1/2 ton models. All units have two compressors with independent refrigeration circuits to provide 2 stages of cooling. The units were designed for light commercial applications and can be easily installed on a roof curb, slab, or frame. All Predator® units are self-contained and assembled on rigid full perimeter base rails allowing for 3-way forklift access and overhead rigging. Every unit is completely charged, wired, piped, and tested at the factory to provide a quick and easy field installation. All units are convertible between side and down airflow. Independent economizer designs are used on side and down discharge applications, as well as all tonnage sizes. Predator® units are available in the following configurations: cooling only, cooling with electric heat, and cooling with gas heat. Electric heaters are available as factory-installed options and field-installed accessories.

#### DESCRIPTION

Units shall be factory assembled, single package, (Elec/Elec, Gas/Elec), designed for outdoor installation. Units shall have a minimum EER of 9.0. They shall have built in field convertible duct connections for down discharge supply/return or horizontal discharge supply/return and be available with factory installed options or field installed accessories. The units shall be factory wired, piped and charged with R-22 refrigerant and factory tested prior to shipment. All unit wiring shall be both numbered and color coded. The cooling performance shall be rated in accordance with DOE and ARI test procedures. Units shall be CSA certified to ANSI Z21.47 and UL 1995/CAN/CSA No. 236-M90 standards.

#### UNIT CABINET

Unit cabinet shall be constructed of G90 galvanized steel with exterior surfaces coated with a non-chalking, powder paint finish, certified at 750 hours salt spray test per ASTM-B117 standards. Indoor blower sections shall be insulated with up to 1" thick insulation coated on the airside. Aluminum foil faced insulation shall be used in the unit's compartments and be fastened to prevent insulation from entering the air stream. Cabinet doors shall be hinged with tool-less access for easy servicing and maintenance. Full perimeter base rails shall be provided to assure reliable transit of equipment, overhead rigging, fork truck access and proper sealing on roof curb applications. Disposable 2" filters shall be furnished and be accessible through hinged access door. Fan performance measuring ports shall be provided on the outside of the cabinet to allow accurate air measurements of evaporator

fan performance without removing panels or creating bypass of the coils. Condensate pan shall be slide out design, constructed of a non corrosive material, internally sloped and conforming to ASHRAE 62-B9 standards. Condensate connection shall be a minimum of 3/4" I.D. female and be rigid mount connection.

#### INDOOR (EVAPORATOR) FAN ASSEMBLY

Fan shall be a belt drive assembly and include an adjustable pitch motor pulley. Job site selected brake horsepower shall not exceed the motors nameplate horsepower rating plus the service factor. Units shall be designed to operate within the service factor. Fan wheel shall be double inlet type with forward curve blades, dynamically balanced to operate smoothly throughout the entire range of operation. Airflow design shall be constant volume. Bearings shall be sealed and permanently lubricated for longer life and no maintenance. Entire blower assembly and motor shall be slide out design.

#### OUTDOOR (CONDENSER) FAN ASSEMBLY

The outdoor fans shall be of the direct drive type, discharge air vertically, have aluminum blades riveted to corrosion resistant steel spider brackets and shall be dynamically balanced for smooth operation. The outdoor fan motors shall have permanently lubricated bearings internally protected against overload conditions and staged independently. A cleaning window shall be provided on two sides of the units for coil cleaning.

#### REFRIGERANT COMPONENTS

##### Compressors:

- A. Shall be fully hermetic type, direct drive, internally protected with internal high-pressure relief and over temperature protection. The hermetic motor shall be suction gas cooled and have a voltage range of + or - 10% of the unit nameplate voltage.
- B. Shall have internal spring isolation and sound muffling to minimize vibration and noise, and be externally isolated on a dedicated, independent mounting.

##### Coils:

- A. Evaporator and condenser coils shall have aluminum plate fins mechanically bonded to seamless internally enhanced copper tubes with all joints brazed. Special Phenolic coating shall be available as a factory option.
- B. Evaporator and condenser coils shall be of the direct expansion, draw-thru design.

Refrigerant Circuit and Refrigerant Safety Components shall include:

- A. Independent fixed-orifice or thermally operated expansion devices.
- B. Solid core filter drier/strainer to eliminate any moisture or foreign matter.
- C. Accessible service gage connections on both suction and discharge lines to charge, evacuate, and measure refrigerant pressure during any necessary servicing or troubleshooting, without losing charge.
- D. The unit shall have two independent refrigerant circuits, equally split in 50% capacity increments.

Unit Controls:

- A. Unit shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-volt transformer side.
- B. Unit shall incorporate a lockout circuit which provides reset capability at the space thermostat or base unit should any of the following standard safety devices trip and shut off compressor:
  - C. Loss-of-charge/Low-pressure switch.
    - (1) High-pressure switch.
    - (2) Freeze-protection thermostat, evaporator coil. If any of the above safety devices trip, an LED (light-emitting diode) indicator shall flash a diagnostic code that indicates which safety switch has tripped.
- D. Unit shall incorporate "AUTO RESET" compressor over temperature, over current protection.
- E. Unit shall operate with conventional thermostat designs and have a low voltage terminal strip for easy hook-up.
- F. Unit control board shall have on-board diagnostics and fault code display.
- G. Standard controls shall include anti-short cycle and low voltage protection, and permit cooling operation down to 0 °F.
- H. Control board shall monitor each refrigerant safety switch independently.
- I. Control board shall retain last 5 fault codes in non-volatile memory, which will not be lost in the event of a power loss.

**GAS HEATING SECTION (IF EQUIPPED)**

Heat exchanger and exhaust system shall be constructed of aluminized steel and shall be designed with induced draft combustion with post purge logic, energy saving direct spark ignition, and redundant main gas valve. The heat exchanger shall be of the tubular type, constructed of T1-40 aluminized steel for corrosion resistance and allowing minimum mixed air entering temperature of 40 °F. Burners shall be of the in-

shot type, constructed of aluminum-coated steel. All gas piping shall enter the unit cabinet at a single location, through either the side or bottom, without any field modifications. An integrated control board shall provide timed control of evaporator fan functioning and burner ignition. Heating section shall be provided with the following minimum protection:

- A. Primary and auxiliary high-temperature limit switches.
- B. Induced draft pressure sensor.
- C. Flame roll out switch (manual reset).
- D. Flame proving controls. Unit shall have two independent stages of capacity (60% 1<sup>st</sup> stage, 100% 2<sup>nd</sup> stage).

**ELECTRIC HEATING SECTION (IF EQUIPPED)**

An electric heating section, with nickel chromium elements, shall be provided in a range of 9 thru 54 KW, offering two states of capacity all sizes. The heating section shall have a primary limit control(s) (automatic reset) to prevent the heating element system from operating at an excessive temperature. The Heating Section assembly shall slide out of the unit for easy maintenance and service. Units with Electric Heating Sections shall be wired for a single point power supply with branch circuit fusing (where required).

**UNIT OPERATING CHARACTERISTICS**

Unit shall be capable of starting and running at 125 °F outdoor temperature, exceeding maximum load criteria of ARI Standard 210/240. The compressor, with standard controls, shall be capable of operation down to 0 °F outdoor temperature. Unit shall be provided with fan time delay to prevent cold air delivery before heat exchanger warms up. (Gas heat only)

**ELECTRICAL REQUIREMENTS** - All unit power wiring shall enter unit cabinet at a single factory provided location and be capable of side or bottom entry to minimize roof penetrations and avoid unit field modifications. Separate side and bottom openings shall be provided for the control wiring.

**STANDARD LIMITED WARRANTIES** - Compressor – 5 Years, Heat Exchanger – 10 Years, Elect. Heat Elem. – 5 Years, Parts – 1 Year

**FACTORY INSTALLED OPTIONAL OUTDOOR AIR** (Shall be made available by either/or):

1. **ELECTRONIC ENTHALPY AUTOMATIC ECONOMIZER** – Outdoor and return air dampers that are interlocked and positioned by a fully-modulating, spring-return damper actuator. The maximum leakage rate for the outdoor air intake dampers shall not exceed 2% when dampers are fully closed and operating against a pressure differential of 0.5 IWG. A unit-mounted potentiometer shall be provided to adjust the outdoor and return air damper assembly to take in outdoor air to meet the minimum ventilation requirement of the conditioned space during normal operation. During economizer operation, a mixed-air temperature control shall modulate the

outdoor and return air damper assembly to prevent the supply air temperature from dropping below 55 °F. Changeover from compressor to economizer operation shall be provided by an integral electronic enthalpy control that feeds input into the basic module. The outdoor intake opening shall be covered with a rain hood that matches the exterior of the unit. Water eliminator/filters shall be provided. Simultaneous economizer/compressor operation is also possible. Dampers shall fully close on power loss. Available with barometric relief or power exhaust.

2. **MOTORIZED OUTDOOR AIR DAMPERS** – Outdoor and return air dampers that are interlocked and positioned by a 2-position, spring-return damper actuator. The maximum leakage rate for the outdoor air intake dampers shall not exceed 2% when dampers are fully closed and operating against a pressure differential of 0.5 IWG. A unit-mounted potentiometer shall be provided to adjust the outdoor and return air damper assembly to take in the design CFM of outdoor air to meet the ventilation requirements of the conditioned space during normal operation. Whenever the indoor fan motor is energized, the dampers open up to one of two pre-selected positions – regardless of the outdoor air enthalpy. Dampers return to the fully closed position when the indoor fan motor is de-energized. Dampers shall fully close on power loss.

#### ADDITIONAL FACTORY INSTALLED OPTIONS

- **ALTERNATE INDOOR BLOWER MOTOR** – For applications with high restrictions, units are available with optional indoor blower motors that provide higher static output and/or higher airflow.
- **CONVENIENCE OUTLET (POWERED/NON-POWERED)** – Unit can be provided with an optional 120VAC GFCI outlet with cover on the corner of the unit housing the compressors.
- **ELECTRIC HEAT** - Electric heaters range from 9 kW to 54 kW and are available in all the voltage options of the base unit.
- **PHASE MONITOR** - Designed to prevent damage in out-of-phase condition.
- **COIL GUARD** - Designed to prevent condenser coil damage.
- **BAS CONTROLS** - Include supply air sensor, return air sensor, dirty filter indicator and air proving switch.
- **DIRTY FILTER SWITCH** – This kit includes a differential pressure switch that energizes the fault light on the unit thermostat, indicating that there is an abnormally high-pressure drop across the filters.
- **BREAKER** – An HACR breaker can be factory installed on gas heat units or cooling units with electric heat.
- **DISCONNECT SWITCH** - A disconnect can be factory installed on a cooling only units sized for the largest electric heat available.
- **STAINLESS STEEL HEAT EXCHANGER** – For applications in a corrosive environment, this option provides a full stainless steel heat exchanger assembly.
- **STAINLESS STEEL DRAIN PAN** – Provides years of trouble-free operation in corrosive environments.
- **SMOKE DETECTOR** – A smoke detector can be factory mounted and wired in the supply and/or return air compartments.

#### OTHER PRE-ENGINEERED ACCESSORIES AVAILABLE

- **ROOF CURB** - 14" and 8" high, full perimeter knockdown curb, with hinged design for quick assembly.
- **BAROMETRIC RELIEF DAMPER** – (Unit mounted – Downflow, Duct Mounted – Horizontal) – Contains a rain hood, air inlet screen, exhaust damper and mounting hardware. Used to relieve internal air pressure through the unit during economizer operation.
- **PROPANE CONVERSION KIT** – Contains new orifices and gas valve springs to convert from natural to L.P. gas.
- **-60 °F GAS HEAT KIT** – Provides an electric heat kit for the gas compartment for use in extreme low ambient conditions.
- **ECONOMIZER** (Downflow and Horizontal flow)
- **POWER EXHAUST** – (Unit mount – Downflow, Duct mount – Horizontal flow)
- **DUAL ENTHALPY KIT** - Provides a second input to economizer to monitor return air.

Subject to change without notice. Printed in U.S.A.  
Copyright © 2004 by Unitary Products. All rights reserved.

036-21058-005-A-0704  
Supersedes: 036-21058-004-C-0504

---

**Unitary  
Products  
Group**

**5005  
York  
Drive**

**Norman  
OK  
73069**